

ADDENDUM #1
REHABILITATION AND RELINE OF BREWERY CREEK STORM SEWER SECTION 29 & 31
CITY OF DULUTH
PROJECT No. 0036ST
BID No. 15-0527
August 17, 2015

NOTICE

This Addendum is issued to modify, explain or correct the original drawings, specifications and/or previous addenda and is hereby made a part of the Contract Documents. Please attach this Addendum to the specification and note receipt of this Addendum on the Request for Bid.

DRAWINGS

1. The entire plans set has been replaced with the attached plan set signed by the Project Engineer and dated 8-14-2015. The change to the plan is the deletion of Lining Sewer Pipe 63" and replaced with Lining Sewer Pipe 60".

SPECIFICATIONS

1. SP-11 Subletting of Contract: is supplemented with the following:

The verbiage *LINING SEWER PIPE 63"*, has been deleted.

2. SP-24 (2503) LINING SEWER PIPE 60" OR 63" is supplemented with the following:

The verbiage *OR 63"* has been deleted.

3. EXHIBIT A is supplemented with the following:

A new EXHIBIT A has been attached, with the bid item for LINING SEWER PIPE 63" have been deleted. The quantity for LINING SEWER PIPE 60" has been increased from 268 l.f. to 394 l.f..

INFORMATION TO BIDDERS

N/A

END OF ADDENDUM

Schedule of Prices

REHABILITATION AND RELINE OF BREWERY CRK STORM SEWER SECTIONS 29 & 31

BID ITEM	SPEC. NO.	ITEM	UNIT	TOTAL EST. QUANTITY	UNIT PRICE	TOTAL PRICE
1	2021.501	MOBILIZATION	LUMP SUM	1		
2	2104.501	REMOVE CURB AND GUTTER	LIN FT	86		
3	2104.503	REMOVE CONCRETE FLOOR	SQ FT	800		
4	2104.503	REMOVE CONCRETE WALK	SQ FT	800		
5	2104.503	REMOVE BITUMINOUS PAVEMENT	SQ FT	3925		
6	2104.501	REMOVE PIPE SEWERS	LIN FT	24		
7	2104.513	SAWING BITUMINOUS PAVEMENT (FULL DEPTH)	LIN FT	260		
8	2105.521	SELECT GRANULAR BORROW MOD. 7% (CV)	CU YD	760		
9	2105.601	DEWATERING	LUMP SUM	1		
10	2105.601	TEMPORARY STREAM DIVERSION SYSTEM	LUMP SUM	1		
11	2211.503	AGGREGATE BASE (CV) CLASS 5	CU YD	120		
12	2301.607	PRESSURE GROUT	CU YD	10		
13	2360.501	TYPE SP 12.5 WEARING COURSE MIXTURE (3,C)	TON	105		
14	2401.601	STRUCTURE EXCAVATION CLASS E	LUMP SUM	1		
15	2503.511	12" PVC PIPE SEWER	LIN FT	24		
16	2503.603	LINING SEWER PIPE 60"	LIN FT	394		
18	2506.501	CONSTRUCT DRAINAGE STRUCTURE DESIGN A OR F	LIN FT	23.1		
19	2506.516	CASTING ASSEMBLY	EACH	2		
20	2511.515	GEOTEXTILE FILTER TYPE V	SQ YD	530		
21	2521.501	5" CONCRETE WALK	SQ FT	475		
22	2531.501	CONCRETE CURB AND GUTTER DESIGN B624	LIN FT	26		
23	2531.501	CONCRETE CURB AND GUTTER DESIGN D424	LIN FT	60		
24	2563.601	TRAFFIC CONTROL	LUMP SUM	1		
25	2564.602	INSTALL SIGN	EACH	1		
26	2573.53	STORM DRAIN INLET PROTECTION	EACH	5		
27	2575.505	SODDING TYPE LAWN	SQ YD	170		
28	2582.501	PAVEMENT MESSAGE (HANDICAPPED SYMBOL) PAINT	EACH	1		
29	2582.502	4" SOLID LINE WHITE-PAINT	LIN FT	54		

TOTAL :

INITIAL

CASTING ASSEMBLY INFORMATION					
TYPE OF STRUCTURE	CATCH BASIN - STORM (PCB-3)			MANHOLE - STORM (PMH-5)	
	FRAME	GRATE	CURB BOX	FRAME	LID
CASTING DESCRIPTION	STRM-2	STRM-2	STRM-2	STRM-1	STRM-1
CITY STD. PLATE NUMBER	STRM-2	STRM-2	STRM-2	STRM-1	STRM-1
HEIGHT IN FEET	0.75	0.13	1.05	0.67	NA
NUMBER REQUIRED	1	1	1	1	1
STANDARD PLATE NUMBER	4129G	4154B	4160D	4101D	NA
STRUCTURE TYPE	DESIGN F			DESIGN F	


STANDARD PLATES - MnDOT	
THE FOLLOWING STANDARD PLATES, APPROVED BY THE FEDERAL HIGHWAY ADMINISTRATION, SHALL APPLY ON THIS PROJECT.	
PLATE NO.	DESCRIPTION
3000L	REINFORCED CONCRETE PIPE
3006G	GASKET JOINT FOR R.C. PIPE
3145G	CONCRETE PIPE OR PRECAST BOX CULVERT TIES
4005M	MANHOLE OR CATCH BASIN TYPE A & B CONE SECTIONS PRECAST DESIGN F
4010H	CONCRETE SHORT CONE AND ADJUSTING RING
4101D	RING CASTING FOR MANHOLE OR CATCH BASIN
7035N	CONCRETE WALK & CURB RETURNS AT ENTRANCES
7100H	CONCRETE CURB AND GUTTER DESIGN B AND DESIGN V
7102J	CONCRETE CURB AND GUTTER DESIGN D
8000I	STANDARD BARRICADES
8337C	TEMPORARY PORTABLE PRECAST CONCRETE BARRIER
9102E	TURF ESTABLISHMENT AREAS (AT PIPE CULVERT ENDS)

STANDARD PLATES - CITY OF DULUTH	
THE FOLLOWING STANDARD PLATES, APPROVED BY THE CITY OF DULUTH, SHALL APPLY ON THIS PROJECT.	
PLATE NO.	DESCRIPTION
STRM-1	STORM MANHOLE CASTING
STRM-2	CATCH BASIN/CURB BOX CASTINGS

DIRECTORY OF KNOWN UTILITIES		
COMPANY	SERVICE	TELEPHONE
GOPHER STATE ONE CALL	LOCATORS	800-252-1166
MINNESOTA POWER	ELECTRIC POWER	218-722-1972
CENTURYLINK	TELEPHONE	218-741-9340
CITY OF DULUTH	WATER & SEWER	218-730-4000
CITY OF DULUTH	NATURAL GAS	218-730-4100

KEY NOTES:

- ① CONTRACTOR DESIGNED TEMPORARY STREAM DIVERSION PLAN TO BE APPROVED BY ENGINEER PRIOR TO START OF WORK. SEE SPECIAL PROVISIONS FOR REQUIREMENTS.
- ② BASIS OF PAYMENT IS 115 LBS. PER SQ. YD. INCH.
- ③ REPAINT PARKING LINES REMOVED DURING PHASE B SEWER ACCESS EXCAVATION.
- ④ LINING SIZE SHOWN REFERS TO FINISHED INSIDE DIMENSION OF NEW LINING.
- ⑤ TO INCLUDE ALL DEWATERING NECESSARY FOR COMPLETION OF THE WORK INCLUDING CONCRETE REMOVAL, REPAIRS AND SEWER LINING.
- ⑥ SEE SHEET 09 FOR LOCATION.
- ⑦ PHASE A SHALL BE CONSTRUCTED FIRST AND SUBSTANTIALLY COMPLETE PRIOR TO STARTING PHASE B.
- ⑧ FOR FILLING VOID BEHIND PIPE IN SECTION 29, STA. 47+42.

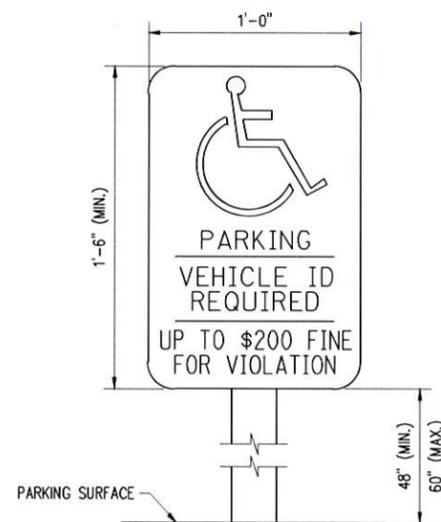

SIGN DETAIL

- NOTES:**
- USE MN/DOT STANDARD SIGN R7-8m.
 - COLOR: WHITE LEGEND AND BORDER ON BLUE RELECTORIZED BACKGROUND.
 - SIGN LOCATION TO BE DETERMINED BY ENGINEER IN THE FIELD.

STATEMENT OF ESTIMATED QUANTITIES							
BID ITEM	SPEC. NO.	ITEM	UNIT	PHASE A ⑦ EST. QTY.	PHASE B ⑦ EST. QTY.	TOTAL EST. QUANTITY	FINAL QUANTITY
1	2021.501	MOBILIZATION	LUMP SUM	0.3	0.7	1.0	
2	2104.501	REMOVE CURB AND GUTTER	LIN FT	86	0	86	
3	2104.503	REMOVE CONCRETE FLOOR	SQ FT	260	540	800	
4	2104.503	REMOVE CONCRETE WALK	SQ FT	800	0	800	
5	2104.503	REMOVE BITUMINOUS PAVEMENT	SQ FT	2110	1815	3925	
6	2104.501	REMOVE PIPE SEWERS	LIN FT	0	24	24	
7	2104.513	SAWING BITUMINOUS PAVEMENT (FULL DEPTH)	LIN FT	130	130	260	
8	2105.521	SELECT GRANULAR BORROW MOD. 7% (CV)	CU YD	410	350	760	
⑤ 9	2105.601	DEWATERING	LUMP SUM	0.3	0.7	1.0	
① 10	2105.601	TEMPORARY STREAM DIVERSION SYSTEM	LUMP SUM	0.3	0.7	1.0	
11	2211.503	AGGREGATE BASE (CV) CLASS 5	CU YD	70	50	120	
⑧ 12	2301.607	PRESSURE GROUT	CU YD	0	10	10	
② 13	2360.501	TYPE SP 12.5 WEARING COURSE MIXTURE (3,C)	TON	55	50	105	
14	2401.601	STRUCTURE EXCAVATION CLASS E	LUMP SUM	0.3	0.7	1.0	
15	2503.511	12" PVC PIPE SEWER	LIN FT	0	24	24	
④ 16	2503.603	LINING SEWER PIPE 60"	LIN FT	126	268	394	
17	2506.501	CONSTRUCT DRAINAGE STRUCTURE DESIGN A OR F	LIN FT	11.8	11.3	23.1	
18	2506.516	CASTING ASSEMBLY	EACH	1	1	2	
19	2511.515	GEOTEXTILE FILTER TYPE V	SQ YD	270	260	530	
20	2521.501	5" CONCRETE WALK	SQ FT	475	0	475	
⑥ 21	2531.501	CONCRETE CURB AND GUTTER DESIGN B624	LIN FT	26	0	26	
⑥ 22	2531.501	CONCRETE CURB AND GUTTER DESIGN D424	LIN FT	60	0	60	
23	2563.601	TRAFFIC CONTROL	LUMP SUM	0.3	0.7	1.0	
24	2564.602	INSTALL SIGN	EACH	1	0	1	
25	2573.530	STORM DRAIN INLET PROTECTION	EACH	1	4	5	
26	2575.505	SODDING TYPE LAWN	SQ YD	140	30	170	
27	2582.501	PAVEMENT MESSAGE (HANDICAPPED SYMBOL) PAINT	EACH	1	0	1	
③ 28	2582.502	4" SOLID LINE WHITE-PAINT	LIN FT	0	54	54	

WARNING
LOCATION OF UNDERGROUND UTILITIES
TO BE VERIFIED BY CONTRACTOR.
CALL BEFORE DIGGING.
GOPHER STATE ONE CALL
1-800-252-1166
REQUIRED BY LAW

THE SUBSURFACE UTILITY INFORMATION IN THIS PLAN IS UTILITY LEVEL D.
THIS QUALITY LEVEL WAS DETERMINED ACCORDING TO THE GUIDELINES OF
CI/ASCE 38-02, ENTITLED "STANDARD GUIDELINES FOR COLLECTION
AND DEPICTION OF EXISTING SUBSURFACE UTILITY DATA".

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: Jon W. Sitter LIC. NO. 25128 DATE 08/14/2015

City of Duluth Proj. No. 0036ST

STATEMENT OF ESTIMATED QUANTITIES

Sheet No. 02 of 13 Sheets

1. GENERAL REQUIREMENTS FOR CONSTRUCTION ACTIVITY

A. EROSION PREVENTION: THE CONTRACTOR MUST PLAN FOR AND IMPLEMENT CONSTRUCTION PRACTICES THAT MINIMIZE EROSION SO THAT INSPECTION AND MAINTENANCE REQUIREMENTS OF THE GENERAL STORMWATER PERMIT ARE MET. COMMON EROSION PREVENTION PRACTICES INCLUDE:

- 1) MARKING AND DELINEATING AREAS OF THE SITE NOT TO BE DISTURBED (WITH FLAGS, STAKES, SIGNS, SILT FENCE, ETC.).
2) STABILIZING ALL EXPOSED SOIL AREAS AS SOON AS POSSIBLE, BUT IN NO CASE LATER THAN 7 DAYS AFTER CONSTRUCTION ACTIVITY IN THAT PORTION OF THE SITE HAS TEMPORARILY OR PERMANENTLY CEASED.
3) STABILIZE THE LAST 200 LINEAL FEET OF ANY TEMPORARY OR PERMANENT DRAINAGE DITCH OR SWALE WITHIN 24 HOURS AFTER CONNECTING TO RECEIVING SURFACE WATER OR STORM SEWER INLET.
4) PROVIDE TEMPORARY OR PERMANENT ENERGY DISSIPATION TO PIPE OUTLETS WITHIN 24 HOURS OF CONNECTING TO A SURFACE WATER.

B. SEDIMENT CONTROL: THE CONTRACTOR MUST PLAN FOR AND IMPLEMENT CONSTRUCTION PRACTICES THAT MINIMIZE SEDIMENT FROM ENTERING SURFACE WATERS, INCLUDING BUT NOT LIMITED TO: CURB AND GUTTER SYSTEMS AND STORM SEWER INLETS. COMMON SEDIMENT CONTROL PRACTICES INCLUDE:

- 1) DO NOT ALLOW ANY UNBROKEN SLOPE LENGTH GREATER THAN 75 FEET FOR 3:1 (H:V) SLOPES OR STEEPER IN ORDER TO MAINTAIN SHEET FLOW AND MINIMIZE RILLS AND GULLIES.
2) ALL SEDIMENT CONTROL BMPs MUST BE ESTABLISHED ON ALL DOWN GRADIENT PERIMETERS BEFORE ANY UPGRADE LAND DISTURBING ACTIVITIES CAN BEGIN AND SHALL REMAIN IN PLACE UNTIL FINAL STABILIZATION IS ESTABLISHED.
3) THE TIMING FOR SEDIMENT CONTROL BMPs MAY BE ADJUSTED TO ACCOMMODATE SHORT-TERM CONSTRUCTION ACTIVITIES, SUCH AS CLEARING AND GRUBBING OR PASSAGE OF VEHICLES, AND MUST BE COMPLETED AS QUICKLY AS POSSIBLE. SEDIMENT CONTROL BMPs MUST BE INSTALLED IMMEDIATELY AFTER SHORT-TERM CONSTRUCTION IS COMPLETE, OR BEFORE THE NEXT PRECIPITATION EVENT IF THE ACTIVITY IS NOT COMPLETE.
4) PROTECT ALL STORM DRAIN INLETS WITH APPROPRIATE BMPs DURING CONSTRUCTION UNTIL ALL SOURCES WITH POTENTIAL FOR DISCHARGING TO THE INLET HAVE BEEN STABILIZED. INLET PROTECTION MAY ONLY BE REMOVED EARLIER IF SPECIFIC SAFETY CONCERNS (STREET FLOODING/FREEZING) HAVE BEEN BROUGHT FORTH IN WRITING BY JURISDICTIONAL AUTHORITY.
5) TEMPORARY STOCKPILES MUST HAVE SILT FENCE OR OTHER EFFECTIVE SEDIMENT CONTROLS, AND CANNOT BE PLACED IN ANY SURFACE WATERS, INCLUDING STORMWATER CONVEYANCES SUCH AS CURB AND GUTTER SYSTEMS OR DITCHES.
6) ALL VEHICLE TRACKING OF SEDIMENT FROM THE CONSTRUCTION SITE, OR ONTO STREETS WITHIN THE SITE, MUST BE MINIMIZED BY BMPs SUCH AS STONE PADS, CONCRETE OR STEEL WASH RACKS, OR EQUIVALENT SYSTEMS. STREET SWEEPING MUST BE PERFORMED IF BMPs ARE NOT ADEQUATE TO PREVENT SEDIMENT FROM BEING TRACKED ONTO THE STREETS / ROADWAYS.

C. DEWATERING AND BASIN DRAINING: THE CONTRACTOR MUST ENSURE THAT ALL WATER FROM DEWATERING OR BASIN DRAINING ACTIVITIES ARE DISCHARGED IN A MANNER THAT DOES NOT CAUSE NUISANCE CONDITIONS, EROSION IN RECEIVING CHANNELS OR DOWNSLOPE PROPERTIES, OR INUNDATION IN WETLANDS CAUSING SIGNIFICANT ADVERSE IMPACTS TO THE WETLANDS. ANY TURBID OR SEDIMENT LADEN DISCHARGE WATER MUST BE ADEQUATELY TREATED BY DISCHARGING TO A TEMPORARY OR PERMANENT SEDIMENTATION BASIN ON THE PROJECT SITE WHENEVER POSSIBLE, OR TREATED WITH APPROPRIATE BMPs IF THE WATER CANNOT BE DISCHARGED TO A SEDIMENT BASIN. THE CONTRACTOR MUST VISUALLY CHECK THE TREATED STORMWATER PRIOR TO DISCHARGING TO RECEIVING WATERS TO ENSURE ADEQUATE TREATMENT IS BEING MET.

D. INSPECTIONS AND MAINTENANCE: THE CONTRACTOR MUST ROUTINELY INSPECT THE ENTIRE CONSTRUCTION SITE AT LEAST ONCE EVERY SEVEN (7) CALENDAR DAYS DURING CONSTRUCTION AND WITHIN 24 HOURS AFTER A RAINFALL EVENT GREATER THAN 0.5 INCHES OVER 24 HOURS. INSPECTION OF AREAS WITH PERMANENT COVER MAY BE REDUCED TO ONCE PER MONTH. THE CONTRACTOR SHALL RECORD IN WRITING ALL INSPECTION AND MAINTENANCE ACTIVITY ON FORMS WITH INFORMATION REQUIRED BY PART IV.E.2 OF THE GENERAL STORMWATER PERMIT. ALL NONFUNCTIONAL BMPs MUST BE REPAIRED, REPLACED, OR SUPPLEMENTED WITH FUNCTIONAL BMPs WITHIN 24 HOURS AFTER DISCOVERY, OR AS SOON AS FIELD CONDITIONS ALLOW ACCESS. COMMON ROUTINE MAINTENANCE ACTIVITIES INCLUDE:

- 1) ALL SILT FENCE MUST BE REPAIRED, REPLACED, OR SUPPLEMENTED WHEN THEY BECOME NONFUNCTIONAL OR THE SEDIMENT REACHES 1/3 OF THE FENCE HEIGHT WITHIN 24 HOURS OF DISCOVERY OR AS SOON AS FIELD CONDITIONS ALLOW ACCESS.
2) DRAIN ALL TEMPORARY AND PERMANENT SEDIMENTATION BASINS AND REMOVE SEDIMENT WHEN THE DEPTH OF SEDIMENT COLLECTED IN THE BASIN REACHES 1/2 THE STORAGE VOLUME WITHIN 72 HOURS OF DISCOVERY OR AS SOON AS FIELD CONDITIONS ALLOW ACCESS.
3) REMOVE ALL DEPOSITED SEDIMENT FROM SURFACE WATERS AND STORMWATER CONVEYANCE SYSTEMS (DITCHES, CURB AND GUTTERS, CATCH BASINS, ETC.) AND RESTABILIZE THE AREAS WHERE SEDIMENT REMOVAL RESULTS IN EXPOSED SOIL WITHIN 7 DAYS OF DISCOVERY OR AFTER OBTAINING PERMISSION FROM JURISDICTIONAL AUTHORITIES.
4) REMOVE ANY TRACKED SEDIMENT FROM ALL PAVED SURFACES WITHIN 24 HOURS AFTER DISCOVERY OR SOONER AS REQUIRED FOR PERMIT COMPLIANCE.
5) REMOVE ANY SEDIMENT THAT ESCAPES THE CONSTRUCTION SITE IN A MANNER AND AT A FREQUENCY SUFFICIENT TO MINIMIZE OFF-SITE IMPACTS AND SAFETY HAZARDS.
6) OPERATE, MAINTAIN, AND INSPECT ANY TEMPORARY OR PERMANENT WATER QUALITY MANAGEMENT BMPs TO ENSURE ADEQUATE TREATMENT IS BEING MET.

E. POLLUTION PREVENTION MANAGEMENT MEASURES: THE CONTRACTOR MUST MANAGE AND IMPLEMENT POLLUTION PREVENTION MEASURES TO PREVENT AIR, LAND, AND WATER CONTAMINATION AND MEET REGULARY COMPLIANCE. COMMON POLLUTION PREVENTION MANAGEMENT MEASURES INCLUDE:

- 1) COLLECT SOLID WASTE (SEDIMENT, CONSTRUCTION AND DEMOLITION DEBRIS, ASPHALT/CONCRETE MILLINGS, FLOATING DEBRIS, PAPER, PLASTIC, FABRIC, ETC) AND DISPOSE IN COMPLIANCE WITH MPCA REQUIREMENTS.
2) STORE HAZARDOUS MATERIALS (FUEL, PAINT, ETC.) AND PROVIDE SECONDARY CONTAINMENT TO PREVENT SPILLS, LEAKS, AND OTHER DISCHARGE. RESTRICT ACCESS TO STORAGE AREAS AND DISPOSE OF HAZARDOUS WASTE IN COMPLIANCE WITH MPCA REQUIREMENTS.
3) LIMIT EXTERNAL WASHING OF TRUCKS AND CONSTRUCTION VEHICLES TO A DEFINED AREA OF SITE. CONTAIN RUNOFF AND PROPERLY DISPOSE OF WASTE. NO ENGINE DEGREASING IS ALLOWED ON SITE.
4) ALL LIQUID AND SOLID WASTE GENERATED BY CONCRETE WASHOUT OPERATIONS MUST BE CONTAINED IN A LEAK-PROOF CONTAINMENT FACILITY OR IMPERMEABLE LINER ONSITE. NO LIQUID OR SOLID WASTE MUST CONTACT THE GROUND AND NO RUNOFF IS ALLOWED FROM THE CONCRETE WASHOUT OPERATIONS OR AREA. ALL WASTE MUST BE PROPERLY DISPOSED IN COMPLIANCE WITH MPCA REGULATIONS. A SIGN MUST BE INSTALLED NEAR EACH WASHOUT FACILITY TO INFORM CONCRETE EQUIPMENT OPERATORS TO UTILIZE THE PROPER FACILITIES.

F. FINAL STABILIZATION: THE CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING FINAL STABILIZATION FOR THE SITE AS DESCRIBED IN PART IV.G OF THE GENERAL STORMWATER PERMIT. SPECIFIC CONDITIONS REQUIRED FOR FINAL STABILIZATION INCLUDE:

- 1) ALL SOIL DISTURBING ACTIVITIES AT THE SITE HAVE BEEN COMPLETED AND ALL SOILS ARE STABILIZED BY A UNIFORM PERENNIAL VEGETATIVE COVER WITH A DENSITY OF 70% OVER THE ENTIRE PEROUS SURFACE AREA, OR OTHER EQUIVALENT MEANS NECESSARY TO PREVENT SOIL FAILURE UNDER EROSION CONDITIONS. ALL TEMPORARY SYNTHETIC AND STRUCTURAL EROSION PREVENTION AND SEDIMENT CONTROL BMPs MUST BE LEFT IN-PLACE UNTIL RESTORATION GOAL IS MET - 70% DENSITY.
2) ALL PERMANENT STORMWATER TREATMENT SYSTEMS ARE OPERATIONAL AND ALL SEDIMENT IS REMOVED FROM TEMPORARY AND PERMANENT SEDIMENTATION BASINS AND CONVEYANCE SYSTEMS.
3) BMPs DESIGNED TO DECOMPOSE MAY BE LEFT IN PLACE.

2. EROSION CONTROL RESPONSIBILITIES

A. THE CONTRACTOR IS RESPONSIBLE FOR OVERSEEING THE EROSION CONTROL IMPLEMENTATION AND THE INSTALLATION, INSPECTION, AND MAINTENANCE OF ALL EROSION PREVENTION AND SEDIMENT CONTROL BMPs BEFORE AND DURING CONSTRUCTION. THE FOLLOWING PERSON IS DESIGNATED TO PERFORM THESE DUTIES ON BEHALF OF THE CONTRACTOR AND IS TRAINED AND CERTIFIED TO INSPECT AND INSTALL BMPs AND/OR MANAGE SITES COVERED UNDER THE GENERAL STORMWATER PERMIT:

B. THE OWNER IS RESPONSIBLE FOR THE LONG-TERM OPERATION AND MAINTENANCE OF PERMANENT STORMWATER MANAGEMENT SYSTEM. THE FOLLOWING PERSON IS DESIGNATED TO PERFORM THESE DUTIES: CITY OF DULUTH

C. THE GENERAL CONTRACTOR IS IN CHARGE OF ALL EROSION CONTROL IMPLEMENTATION ON THE SITE AND WILL BE ACCOUNTABLE FOR ALL OTHER CONTRACTORS WORKING ON SITE AND THEIR COMPLIANCE WITH GENERAL STORMWATER PERMIT AND SWPPP REQUIREMENTS.

3. REGULATORY AGENCIES AND PERMITS

A. THE CONTRACTOR SHALL COMPLY WITH REQUIREMENTS OF ALL REGULATORY AGENCIES AND PERMITS HAVING JURISDICTION DURING CONSTRUCTION ACTIVITIES. IN ADDITION TO THE MPCA AND GENERAL STORMWATER PERMIT, THE FOLLOWING REGULATORS AND PERMITS ARE KNOWN TO HAVE SITE JURISDICTION: 1) CITY OF DULUTH - EROSION CONTROL PERMIT

4. GENERAL NATURE OF CONSTRUCTION ACTIVITY DESCRIPTION

A. THE PROJECT INVOLVES THE RELINE OF EXISTING STORM SEWER TOTAL DISTURBED AREA = 0.25 ACRES.

- 1. PARTIAL DECONSTRUCTION OF MANHOLE DRAINAGE STRUCTURE AND SURROUNDING EXCAVATION.

5. IMPERVIOUS SURFACE AREAS (TO NEAREST 1/4 ACRE)

- A. PRE-CONSTRUCTION CONDITIONS: 0.25 ACRES
B. POST-CONSTRUCTION CONDITIONS: 0.25 ACRES
C. NET DIFFERENCE: 0.00 ACRES

6. POTENTIAL FOR SEDIMENT AND POLLUTANTS DISCHARGES FROM THE SITE

- A. SEDIMENT FROM OVERLAND (SHEET) FLOW FROM THE SITE WILL BE CONTAINED BY A PERIMETER CONTROL OF SILT FENCE AND SEDIMENT TRAPS AT POINTS OF DISCHARGE.
B. SEDIMENT AND TURBIDITY FROM DEWATERING ACTIVITIES WILL BE TREATED BY MEANS OF A PORTABLE SEDIMENT CONTAINMENT SYSTEM OR OTHER ENGINEER APPROVED METHOD. THE CONTRACTOR IS RESPONSIBLE TO MEET THE STORMWATER DISCHARGE REQUIREMENTS OF THE COUNTY, AND OTHER AGENCIES WITH REGULATING AUTHORITY. AT A MINIMUM, STORMWATER QUALITY FROM DEWATERING ACTIVITIES AND OTHER DISCHARGES FROM THE SITE MUST MEET THE TURBIDITY AND SEDIMENT LEVELS OF THE RECEIVING SURFACE WATERS.
C. LIQUID AND SOLID WASTE FROM CONCRETE OPERATIONS WILL BE TREATED BY DESIGNATED CONCRETE WASHOUT STATIONS.
D. MAJOR DRAINAGE WAY RUNS THROUGH PROJECT LIMITS. CONTRACTOR SHALL BE PREPARED FOR LARGE RUNOFF VOLUMES & FLOWS FROM RAIN EVENTS.

7. DRAWING REFERENCES

- A. LOCATION AND TYPE OF EROSION PREVENTION AND SEDIMENT CONTROL BMPs
1) TEMPORARY BMPs: SEE SHEET 4
2) PERMANENT BMPs: SEE SHEET 4
B. SITE MAPS
1) EXISTING GRADES: SEE PLAN SHEETS
2) FINAL GRADES: SEE PLAN SHEETS
3) DRAINAGE PATTERNS: SEE SHEET 4
4) IMPERVIOUS SURFACING AND SOIL TYPES: SEE PLAN AND PROFILE SHEETS
5) LOCATION OF AREAS NOT TO BE DISTURBED: SEE PLAN AND PROFILE SHEETS
C. STANDARD DETAILS FOR BMPs: SEE SHEET 4
D. TABULATION OF ESTIMATED PRELIMINARY QUANTITIES FOR BMPs: SEE SHEET 2

8. TIMING/SCHEDULE OF BMP INSTALLATION FOR EROSION PREVENTION AND SEDIMENT CONTROL

- A. PRIOR TO LAND DISTURBANCE ACTIVITIES:
1) INSTALL SILT FENCE AT SITE PERIMETERS AND AROUND AREAS NOT TO BE DISTURBED.
B. DURING CONSTRUCTION ACTIVITIES:
1) INSTALL SILT FENCE AROUND STOCKPILES.
2) INSTALL AND MAINTAIN PORTABLE SEDIMENT CONTAINMENT SYSTEMS FOR TREATING GROUNDWATER FROM DEWATERING OPERATIONS.
3) INSTALL INLET PROTECTION AT NEW CULVERT INLETS AND DITCH FLOW CONTROL DEVICES.
4) CONSTRUCT RIPRAP AT CULVERT OUTLETS AND ELSEWHERE AS SHOWN ON THE PLANS.
5) INSTALL EROSION CONTROL BLANKETS, SOD, AND SEED/MULCH IN AREAS SHOWN ON THE PLANS WHEN LAND DISTURBING ACTIVITIES ARE COMPLETE.

6) INSPECT AND MAINTAIN ALL EROSION PREVENTION AND SEDIMENT CONTROL BMPs, INCLUDING REMOVING SEDIMENT DEPOSITS AND SWEEPING STREETS.

7) ALL DEMOLITION AND REMOVAL OPERATIONS SHALL BE PERFORMED IN A MANNER WHICH CONTAINS ALL DEBRIS FROM ENTERING THE STREAM. IF REMOVAL OPERATIONS RESULT IN DEBRIS ENTERING THE STREAM REMOVAL OPERATIONS SHALL BE SUSPENDED AND METHODS CORRECTED PRIOR TO RESUMING. ANY DEBRIS WHICH DOES ENTER THE STREAM SHALL BE REMOVED.

C. UPON COMPLETION OF LAND DISTURBANCE ACTIVITIES:

- 1) ESTABLISH PERMANENT COVER IN ALL AREAS OF THE SITE AND MAINTAIN UNTIL FINAL STABILIZATION.
2) UPON FINAL STABILIZATION, REMOVE ALL TEMPORARY BMPs (STABILIZED CONSTRUCTION EXITS, INLET PROTECTION, SILT FENCE, CONCRETE WASHOUT STATIONS, PORTABLE SEDIMENT CONTAINMENT SYSTEMS) AND REMOVE ANY SEDIMENT THAT HAS ACCUMULATED IN TEMPORARY BMPs, CONVEYANCE SYSTEMS, SEDIMENT BASINS, AND PERMANENT STORMWATER MANAGEMENT SYSTEMS.

9. PROCEDURES FOR ESTABLISHING ADDITIONAL BMPs FOR SITE CONDITIONS DURING CONSTRUCTION

A. IF ANY DOWN GRADIENT TREATMENT SYSTEM IS OVERLOADED, ADDITIONAL UPGRADE SEDIMENT CONTROL OR REDUNDANT BMPs MUST BE INSTALLED BY THE CONTRACTOR TO ELIMINATE THE OVERLOADING CONDITION. CONTRACTOR SHALL BE PROACTIVE REGARDING EROSION & SEDIMENT CONTROL MEASURES.

10. METHODS OF FINAL STABILIZATION

A. FINAL STABILIZATION WILL BE ACCOMPLISHED BY IMPERVIOUS SURFACING (BITUMINOUS STREETS, CONCRETE SIDEWALKS, CURB AND GUTTER, ASPHALT ROOFTOPS, ETC.) AND VEGETATIVE GROUND COVERS (SODDING AND SEEDING/MULCHING). SPECIFIC CONSTRUCTION METHODS ARE DESCRIBED IN THE PLANS AND SPECIFICATIONS.

11. PERMANENT STORMWATER MANAGEMENT SYSTEMS (NOT REQUIRED)

A. THE PROJECT DOES NOT EXCEED THE THRESHOLD OF 1 ACRE OF NEW IMPERVIOUS THEREFORE NO PERMANENT STORMWATER MANAGEMENT SYSTEM IS REQUIRED.

12. STANDARDS SPECIFICATIONS FOR CONSTRUCTION


A. UNLESS OTHERWISE NOTED IN CONTRACT DOCUMENTS, ALL MATERIAL AND CONSTRUCTION REQUIREMENTS FOR TEMPORARY SEDIMENT CONTROL AND EROSION PREVENTION SHALL BE IN ACCORDANCE WITH THE MINNESOTA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR CONSTRUCTION, 2014 EDITION AND AS MODIFIED BY THE PROJECT SPECIAL PROVISIONS.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA. NAME: Jon W. Sitter LIC. NO. 25128 DATE: 08/14/2015

City of Duluth Proj. No. 0036ST

EROSION CONTROL NOTES

Sheet No. 03 of 13 Sheets

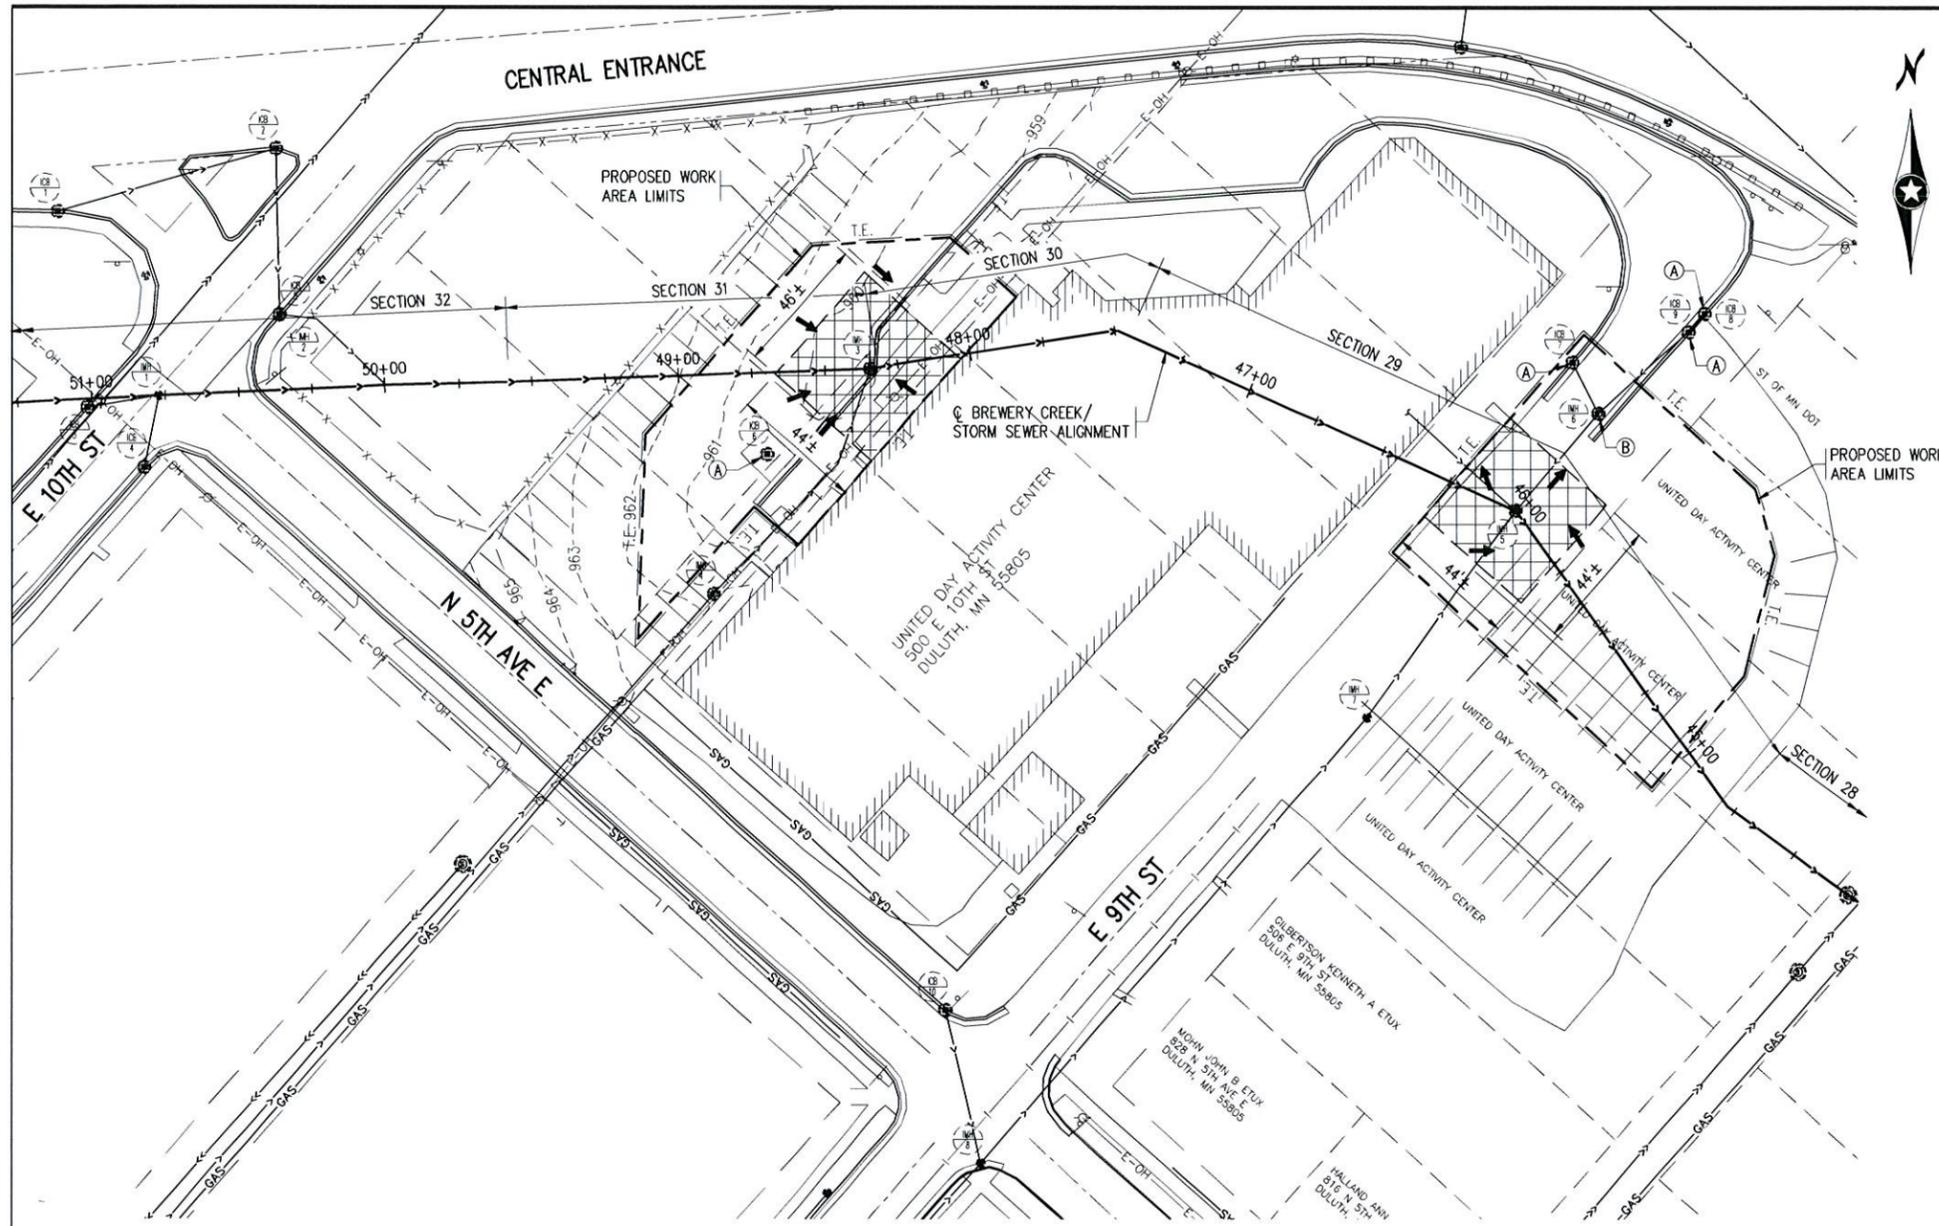


NOTES:

SEE SPECS. 2573, 3137 & 3886.

MANUFACTURED ALTERNATIVES LISTED ON Mn/DOT'S APPROVED PRODUCTS LIST MAY BE SUBSTITUTED.

- ① STORM DRAIN INLET PROTECTION REQUIRED ONLY IF MANHOLE ACCESS LOCATIONS ARE DECONSTRUCTED/EXCAVATED FOR ACCESS DURING STORM SEWER RELINE. SEE SHEETS 9 & 11 FOR DETAILS.
- ② ALL GEOTEXTILE USED FOR INLET PROTECTION SHALL BE MONOFILAMENT IN BOTH DIRECTIONS, MEETING SPEC. 3886.
- ③ FINISHED SIZE, INCLUDING POCKETS WHERE REQUIRED SHALL EXTEND A MINIMUM OF 10 INCHES AROUND THE PERIMETER TO FACILITATE MAINTENANCE OR REMOVAL.
- ④ INSTALLATION NOTES:
DO NOT INSTALL FILTER BAG INSERT IN INLETS SHALLOWER THAN 30 INCHES, MEASURED FROM THE BOTTOM OF THE INLET TO THE TOP OF THE GRATE. THE INSTALLED BAG SHALL HAVE A MINIMUM SIDE CLEARANCE OF 3 INCHES BETWEEN THE INLET WALLS AND THE BAG, MEASURED AT THE BOTTOM OF THE OVERFLOW HOLES. WHERE NECESSARY THE CONTRACTOR SHALL CLINCH THE BAG, USING PLASTIC ZIP TIES, TO ACHIEVE THE 3 INCH SIDE CLEARANCE.
- ⑤ FLAP POCKETS SHALL BE LARGE ENOUGH TO ACCEPT WOOD 2 INCH X 4 INCH OR USE A ROCK SOCK OR SAND BAGS IN PLACE OF THE FLAP POCKETS.
- ⑥ GEOTEXTILE SOCK BETWEEN 4-10 FEET LONG AND 4-6 INCH DIAMETER. SEAM TO BE JOINED BY TWO ROWS OF STITCHING WITH A PLASTIC MESH BACKING OR PROVIDE A HEAT BONDED SEAM (OR APPROVED EQUIVALENT). FILL ROCK LOG WITH OPEN GRADED AGGREGATE CONSISTING OF SOUND DURABLE PARTICLES OF COARSE AGGREGATE CONFORMING TO SPEC. 3137 TABLE 3137-4; CA-35 GRADATION.
- ⑦ FILTER BAG INSERT (EST. 4 EA.) AND ROCK LOG/COMPOST LOG (EST. 1 EA.) TO BE PAID FOR UNDER ITEM "STORM DRAIN INLET PROTECTION".
- ⑧ GEOTEXTILE FILTER TYPE V (EST. 530 SQ. YD.) TO BE PAID FOR UNDER ITEM "GEOTEXTILE FILTER TYPE V".

INLET SPECIFICATIONS AS PER THE PLAN
DIMENSION LENGTH AND WIDTH TO MATCH
FLAP POCKET

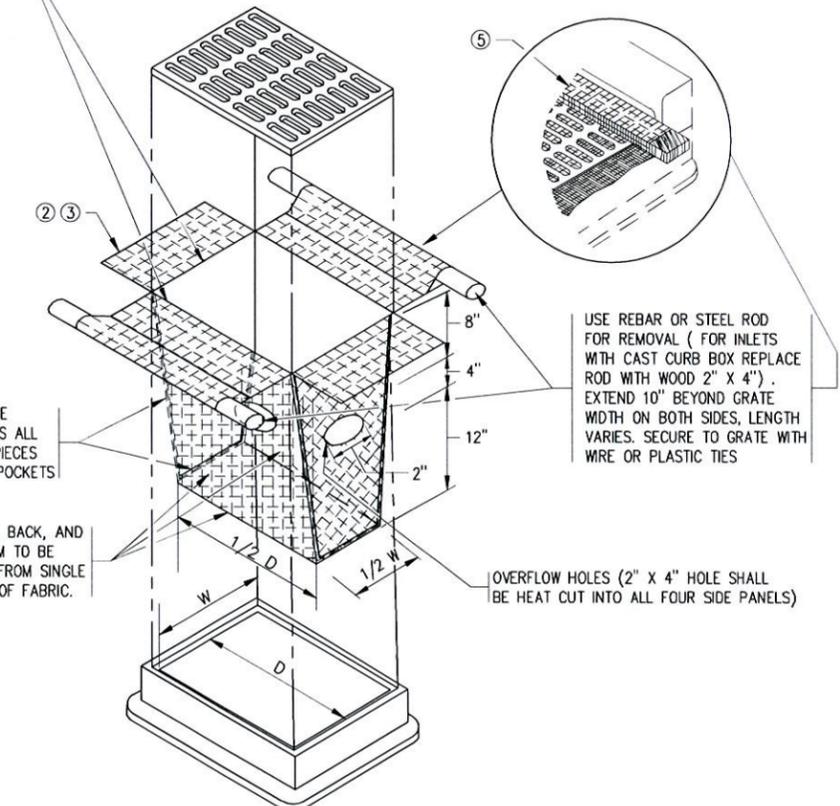


FILTER BAG INSERT ④

(CAN BE INSTALLED IN ANY INLET TYPE WITH OR WITHOUT A CURB BOX)


EROSION CONTROL PLAN ①

LEGEND

- Ⓐ FILTER BAG INSERT (OR EQUIVALENT SYSTEM) ⑦
- Ⓑ ROCK LOG/COMPOST LOG ⑦
- ⓧ MANHOLE ACCESS LOCATION & APPROX. EXCAVATION AREA (PLACE GEOTEXTILE FILTER ON ALL EXPOSED SURFACES) ⑧
- ← DENOTES DRAINAGE FLOW DIRECTION

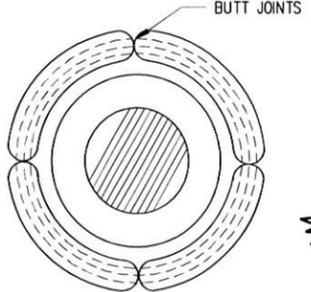

ROCK LOG/COMPOST LOG

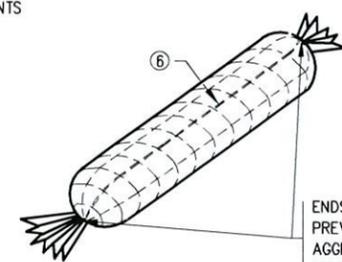


I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015
JON W. SITTER

City of Duluth Proj. No. 0036ST

EROSION CONTROL DETAILS

Sheet No. 04 of 13 Sheets

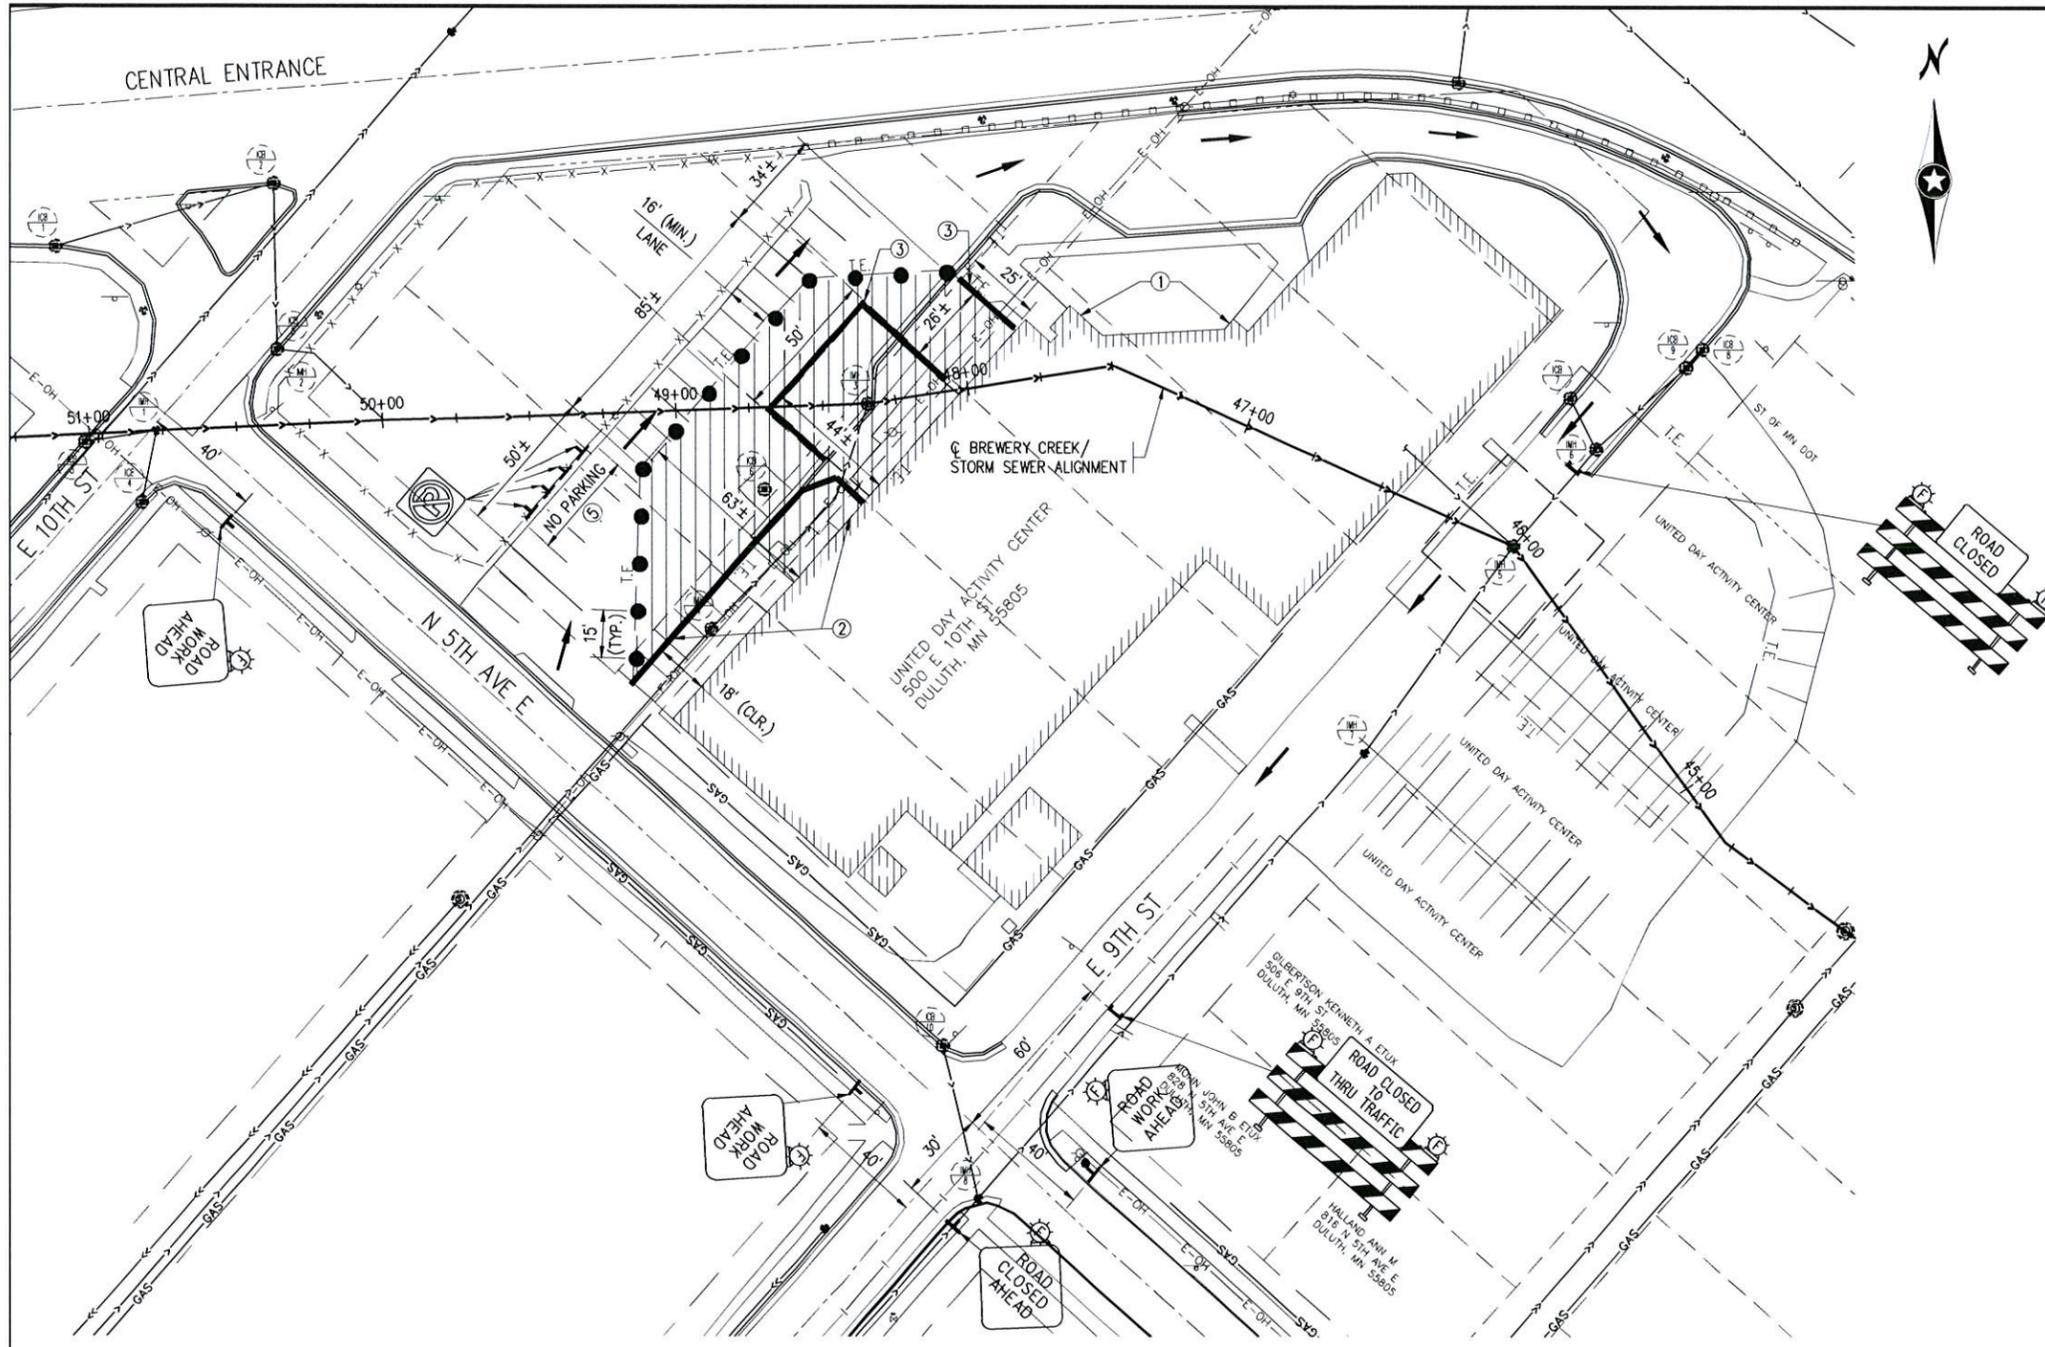

- KEY NOTES:**
- ① CONTRACTOR SHALL PROVIDE ACCESS TO FRONT ENTRANCE OF UDAC BUILDING THROUGHOUT DURATION OF THE PROJECT.
 - ② PRECAST CONCRETE BARRIERS SHALL BE PLACED AS SHOWN TO PROVIDE WALKWAY BETWEEN BUILDING AND BARRIERS.
 - ③ PRECAST CONCRETE BARRIERS TO BE PLACED AROUND PERIMETER OF EXCAVATION LIMITS. CONTRACTOR MAY OMIT BARRIERS WHERE ACCESS IS REQUIRED FOR CONSTRUCTION AND REPLACE WITH ORANGE SAFETY FENCE (INCIDENTAL).
 - ④ INSTALL ORANGE SAFETY FENCE BETWEEN/ALONG PLASTIC DRUMS (INCIDENTAL).
 - ⑤ IN LIEU OF SINGLE POST SIGNAGE, "NO PARKING" SIGNS SHALL BE TEMPORARILY ATTACHED TO EXISTING FENCE/RAILING DURING PHASE A CONSTRUCTION.

- GENERAL NOTES:**
- LAYOUT SHOWN IS APPROXIMATE AND SHALL BE DEPENDENT ON CONTRACTORS OPERATIONS AND EXCAVATION METHOD/REQUIREMENTS.
 - IN NO CASE SHALL THE ACTUAL CONSTRUCTION AREA EXCEED THAT SHOWN WITHOUT PRIOR APPROVAL FROM THE ENGINEER IN THE FIELD.
 - ADJUSTMENTS TO LAYOUT AND LOCATION OF PRECAST CONCRETE BARRIER SHALL BE MADE AS DIRECTED BY THE ENGINEER IN THE FIELD TO ACCOMMODATE FACILITY OPERATION, TRAFFIC, AND OR SAFETY CONCERNS.
 - "PHASE A" AND "PHASE B" TRAFFIC CONTROL SHALL NOT BE IMPLEMENTED CONCURRENTLY. PHASE A SHALL BE IMPLEMENTED FIRST AND ALL WORK EXCEPT FINAL PAVING SHALL BE COMPLETED PRIOR TO BEGINNING WORK AT PHASE B.


TRAFFIC CONTROL PLAN - PHASE A

LEGEND	
	DENOTES TYPE III BARRICADE
	DENOTES SINGLE POST SIGNAGE
	DENOTES PLASTIC DRUM
	DENOTES PRECAST CONCRETE BARRIER
	DENOTES PROPOSED WORK AREA LIMITS ④
	DENOTES TRAFFIC FLOW

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
 NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015
 JON W. SITTER

City of Duluth Proj. No. 0036ST

TRAFFIC CONTROL - PHASE A
 Sheet No. 05 of 13 Sheets

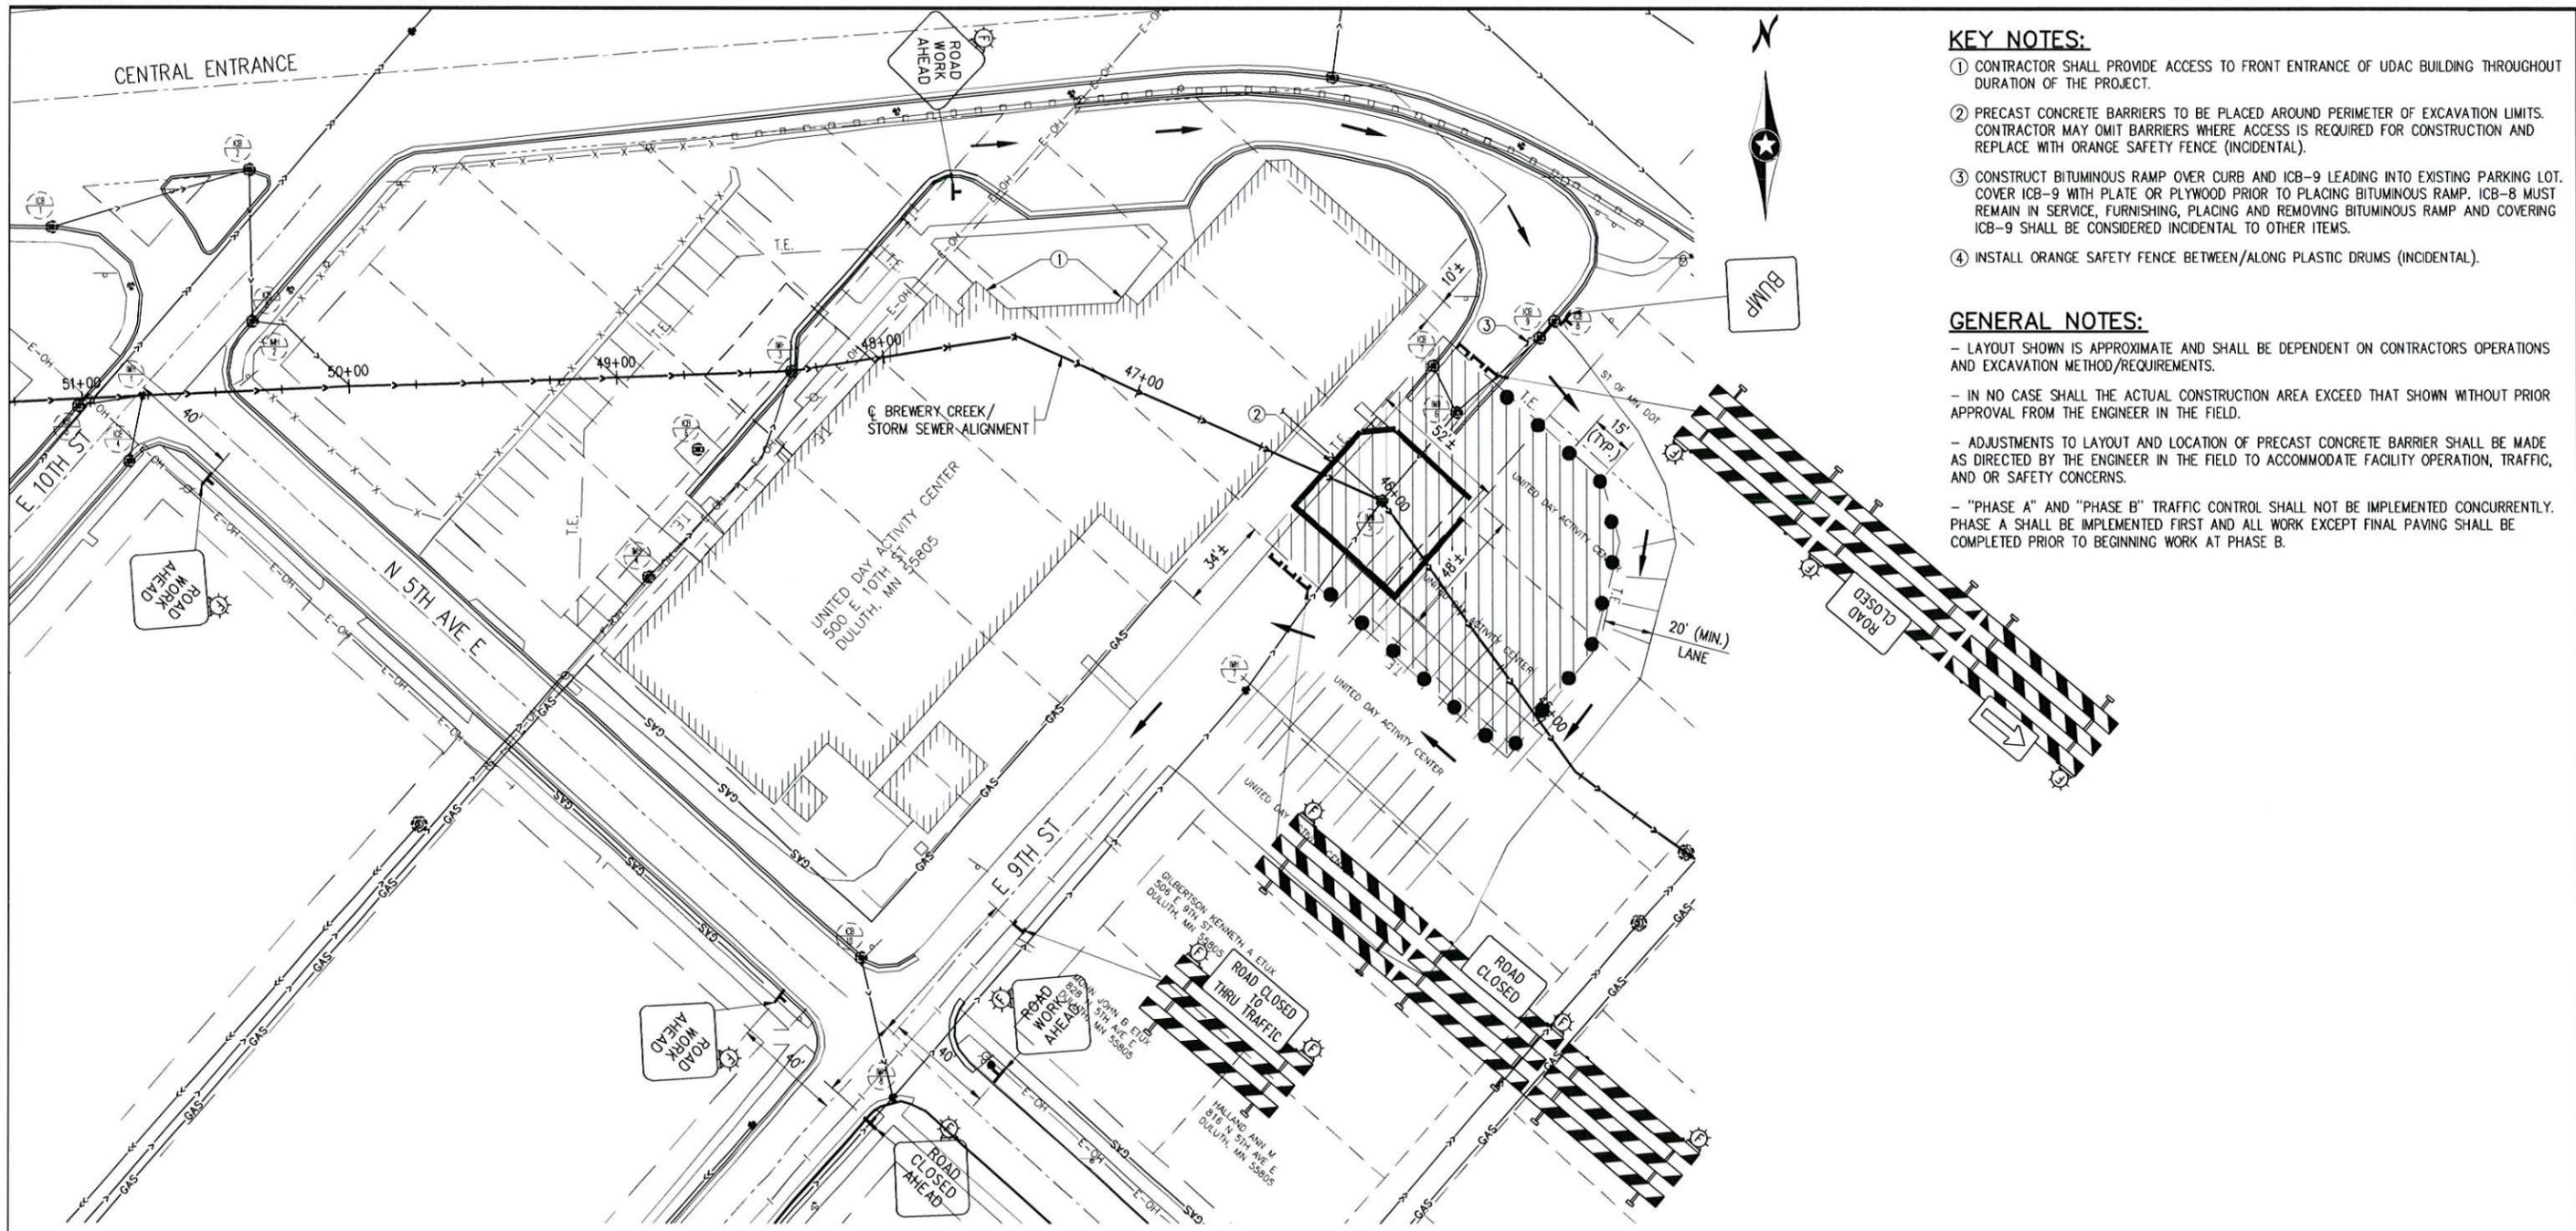

- KEY NOTES:**
- CONTRACTOR SHALL PROVIDE ACCESS TO FRONT ENTRANCE OF UDAC BUILDING THROUGHOUT DURATION OF THE PROJECT.
 - PRECAST CONCRETE BARRIERS TO BE PLACED AROUND PERIMETER OF EXCAVATION LIMITS. CONTRACTOR MAY OMIT BARRIERS WHERE ACCESS IS REQUIRED FOR CONSTRUCTION AND REPLACE WITH ORANGE SAFETY FENCE (INCIDENTAL).
 - CONSTRUCT BITUMINOUS RAMP OVER CURB AND ICB-9 LEADING INTO EXISTING PARKING LOT. COVER ICB-9 WITH PLATE OR PLYWOOD PRIOR TO PLACING BITUMINOUS RAMP. ICB-8 MUST REMAIN IN SERVICE, FURNISHING, PLACING AND REMOVING BITUMINOUS RAMP AND COVERING ICB-9 SHALL BE CONSIDERED INCIDENTAL TO OTHER ITEMS.
 - INSTALL ORANGE SAFETY FENCE BETWEEN/ALONG PLASTIC DRUMS (INCIDENTAL).

- GENERAL NOTES:**
- LAYOUT SHOWN IS APPROXIMATE AND SHALL BE DEPENDENT ON CONTRACTORS OPERATIONS AND EXCAVATION METHOD/REQUIREMENTS.
 - IN NO CASE SHALL THE ACTUAL CONSTRUCTION AREA EXCEED THAT SHOWN WITHOUT PRIOR APPROVAL FROM THE ENGINEER IN THE FIELD.
 - ADJUSTMENTS TO LAYOUT AND LOCATION OF PRECAST CONCRETE BARRIER SHALL BE MADE AS DIRECTED BY THE ENGINEER IN THE FIELD TO ACCOMMODATE FACILITY OPERATION, TRAFFIC, AND OR SAFETY CONCERNS.
 - "PHASE A" AND "PHASE B" TRAFFIC CONTROL SHALL NOT BE IMPLEMENTED CONCURRENTLY. PHASE A SHALL BE IMPLEMENTED FIRST AND ALL WORK EXCEPT FINAL PAVING SHALL BE COMPLETED PRIOR TO BEGINNING WORK AT PHASE B.

TRAFFIC CONTROL PLAN - PHASE B

LEGEND	
	DENOTES TYPE III BARRICADE
	DENOTES SINGLE POST SIGNAGE
	DENOTES PLASTIC DRUM
	DENOTES PRECAST CONCRETE BARRIER
	DENOTES PROPOSED WORK AREA LIMITS ④
	DENOTES TRAFFIC FLOW

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
 NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015
 JOHN W. SITTER

City of Duluth Proj. No. 0036ST

TRAFFIC CONTROL - PHASE B

Sheet No. 06 of 13 Sheets




TRAFFIC CONTROL NOTES

- ① ALL SIGNING INDICATED ON THIS TRAFFIC CONTROL PLAN, EXCEPT THOSE SIGNS WHICH ARE IN PLACE, SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. ALL APPROPRIATE SIGNING, INCLUDING IN PLACE SIGNS, SHALL BE MAINTAINED BY THE CONTRACTOR DURING THE LIFE OF THE CONTRACT. EXISTING STOP SIGNS SHALL BE MAINTAINED FOR THE DURATION OF THE PROJECT.

- ALL TRAFFIC CONTROL DEVICES AND SIGNING SHALL CONFORM TO, AND BE PLACED IN ACCORDANCE WITH, THE "MINNESOTA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES" (MMUTCD) INCLUDING PART VI AND THE FIELD MANUAL FOR TEMPORARY TRAFFIC CONTROL ZONE LAYOUTS DATED JANUARY 2014, THE MINNESOTA STANDARD SIGNS MANUALS PARTS I, II, AND III AND THE APPROPRIATE MATERIAL SPECIFICATIONS.
- ② THE CONTRACTOR SHALL RECEIVE COMPENSATION FOR ALL WORK DESCRIBED HEREIN AND ELSEWHERE IN THESE PLANS ON THE BASIS OF A LUMP SUM PAYMENT FOR ITEM TRAFFIC CONTROL (2563.601).
- ③ THE CONTRACTOR SHALL PLACE ADEQUATE PLASTIC DRUMS, WARNING SIGNS, AND BARRICADES WITHIN THE CONSTRUCTION ZONE TO PROTECT VEHICULAR TRAFFIC AND PEDESTRIAN TRAFFIC FROM CONSTRUCTION OPERATIONS. ADDITIONAL SIGNING MAY INCLUDE, BUT IS NOT LIMITED TO BUMP, DIP, LOOSE GRAVEL, ETC. THE NUMBER AND PLACEMENT OF TRAFFIC CONTROL DEVICES SHALL BE DETERMINED BY THE SEQUENCE OF THE CONTRACTORS OPERATIONS. TRAFFIC CONTROL DEVICES SHALL BE ADJUSTED IN THE FIELD AS DIRECTED BY THE ENGINEER.
- ④ ALL TRAFFIC CONTROL DEVICES SHALL BE REMOVED OR COVERED AS SOON AS THEY ARE NO LONGER REQUIRED OR APPROPRIATE.
- ⑤ THE INITIAL CONSTRUCTION SIGNING SHALL BE ERECTED PRIOR TO CONSTRUCTION OPERATIONS.
- ⑥ TYPE A (LOW INTENSITY) FLASHERS SHALL BE FURNISHED, INSTALLED, AND MAINTAINED ON TYPE III BARRICADES AND ADVANCED WARNING SIGNS WHEN USED AT NIGHT, OR TO IDENTIFY HAZARDS, AND AS DETAILED IN THIS TRAFFIC CONTROL PLAN. ADDITIONAL FLASHERS SHALL BE FURNISHED, INSTALLED, AND MAINTAINED ON SIGNS, BARRICADES, AND CHANNELIZERS AS NEEDED OR AS DIRECTED BY THE ENGINEER FOR TRAFFIC CONTROL THROUGH WORK ZONES WITHIN THE PROJECT LIMITS.
- ⑦ FLAGGING SHALL BE REQUIRED WHEN WORK IS AT THE EDGE OF THE DRIVING LANE TO PROTECT TRAFFIC FROM EXCAVATION AND PAVING OPERATIONS. FLAGGING SHALL BE IN ACCORDANCE WITH THE PERTINENT LAYOUTS SHOWN IN PART VI OF THE MMUTCD, INCLUDING THE FIELD MANUAL DATED JANUARY 2014. ALL SUCH WORK RELATED TO FLAGGING, INCLUDING FLAG PERSONS, SHALL BE CONSTRUED TO BE INCLUDED IN THE LUMP SUM PAYMENT FOR TRAFFIC CONTROL (2563.601).
- ⑧ "ROAD CLOSED AHEAD" SIGNS SHALL BE MOUNTED APPROXIMATELY 250 FT IN ADVANCE OF THE CONSTRUCTION AND THE NEAREST INTERSECTION AND SHALL HAVE A TYPE "A" LOW INTENSITY FLASHING AMBER WARNING LIGHT MOUNTED ON THEM.
- ⑨ "ROAD CLOSED" SIGNS MAY BE USED WHERE THE ROADWAY IS CLOSED TO ALL TRAFFIC EXCEPT CONTRACTOR'S EQUIPMENT OR OFFICIALLY AUTHORIZED VEHICLES.
- ⑩ WHEN A "ROAD CLOSED TO THRU TRAFFIC" SIGN IS USED, THE "STOP" OR "YIELD" SIGN AT THAT INTERSECTION SHALL BE LEFT IN PLACE OR MOVED TO A SUITABLE LOCATION WHERE THE DRIVER CAN STILL SEE THE SIGN.
- ⑪ "ROAD CLOSED TO THRU TRAFFIC" SIGNS SHALL BE LOCATED AT A POINT IN THE STREET AS TO PERMIT LOCAL TRAFFIC USE BUT EFFECTIVELY DISCOURAGE THRU TRAFFIC USE.

TRAFFIC – BILL OF MATERIALS ①

THE FOLLOWING ITEMS ARE INCLUDED AND PAID FOR UNDER SPEC. 2563.601 TRAFFIC CONTROL

SIGN NO.	DEVICE	SIZE ②	NO. REQ'D. PHASE A	NO. REQ'D. PHASE B	NOTES
R8-3		18"x18" BLK. ON WHITE	4	0	
R11-2		48"x30" BLK. ON WHITE	1	2	
R11-4		60"x30" BLK. ON WHITE	1	1	
W1-6L		48"x24" BLK. ON ORANGE	0	1	
W8-1		36"x36" BLK. ON ORANGE	0	1	
W20-1		36"x36" BLK. ON ORANGE	3	4	
W20-3		36"x36" BLK. ON ORANGE	1	1	
TYPE III BARRICADE		8' ORANGE & WHITE	2	5	
TYPE III BARRICADE		8' ORANGE & WHITE	0	2	
PLASTIC DRUM		ORANGE & WHITE	13	17	
TEMPORARY PORTABLE PRECAST CONCRETE BARRIER		32" x 150"	20	14	③
TYPE A FLASHERS		YELLOW	8	13	

KEY NOTES:


- ① POSTS, WEIGHTS AND HARDWARE REQUIRED FOR SIGN PLACEMENT ARE INCIDENTAL ITEMS.
- ② ALL SIGN PANEL DIMENSIONS ARE IN INCHES.
- ③ TOTAL REPRESENTS ESTIMATED MAXIMUM QUANTITY. CONTRACTOR SHALL VERIFY TOTAL QUANTITY NEEDED BASED ON ACCESS LOCATIONS FOR PROPOSED CONSTRUCTION.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
 NAME: Jim W. Sitter LIC. NO. 25128 DATE 08/14/2015
 JIM W. SITTER

City of Duluth Proj. No. 0036ST

TRAFFIC CONTROL NOTES

Sheet No. 07 of 13 Sheets

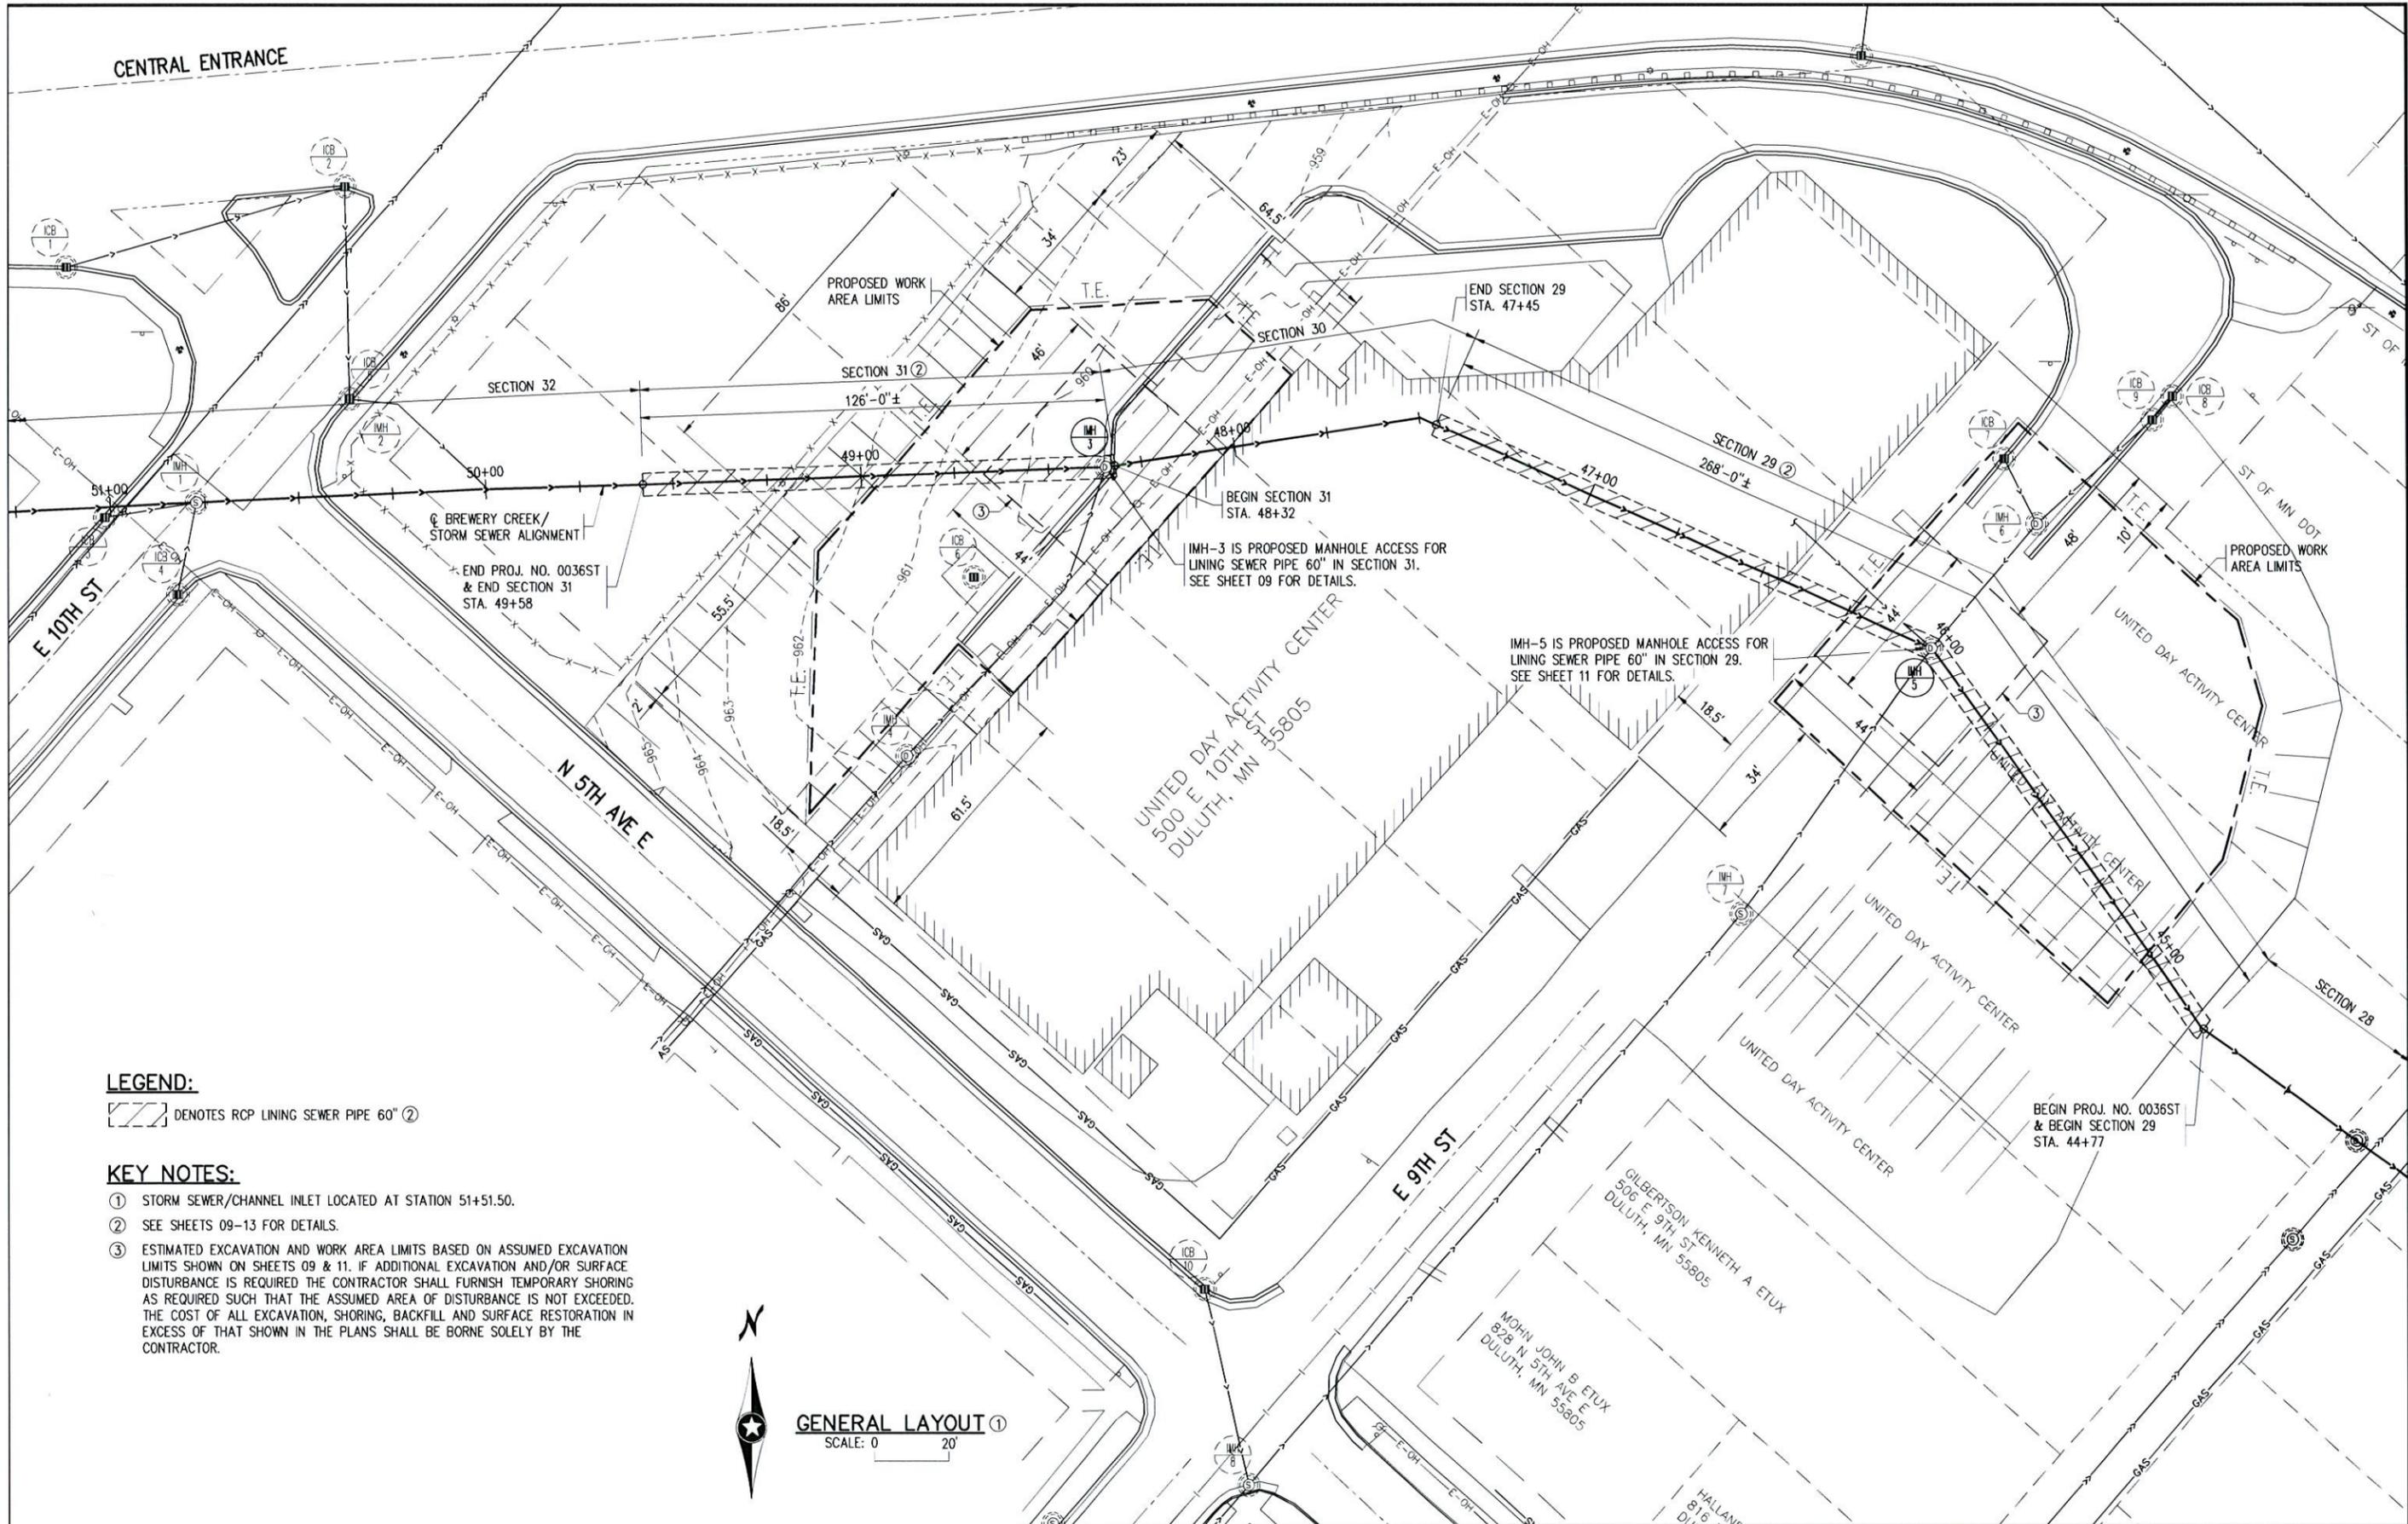

LEGEND:

DENOTES RCP LINING SEWER PIPE 60" (2)

KEY NOTES:

- ① STORM SEWER/CHANNEL INLET LOCATED AT STATION 51+51.50.
- ② SEE SHEETS 09-13 FOR DETAILS.
- ③ ESTIMATED EXCAVATION AND WORK AREA LIMITS BASED ON ASSUMED EXCAVATION LIMITS SHOWN ON SHEETS 09 & 11. IF ADDITIONAL EXCAVATION AND/OR SURFACE DISTURBANCE IS REQUIRED THE CONTRACTOR SHALL FURNISH TEMPORARY SHORING AS REQUIRED SUCH THAT THE ASSUMED AREA OF DISTURBANCE IS NOT EXCEEDED. THE COST OF ALL EXCAVATION, SHORING, BACKFILL AND SURFACE RESTORATION IN EXCESS OF THAT SHOWN IN THE PLANS SHALL BE BORNE SOLELY BY THE CONTRACTOR.




GENERAL LAYOUT ①
SCALE: 0 20'

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015
JOHN W. SITTER

City of Duluth Proj. No. 0036ST

GENERAL PLAN

Sheet No. 08 of 13 Sheets

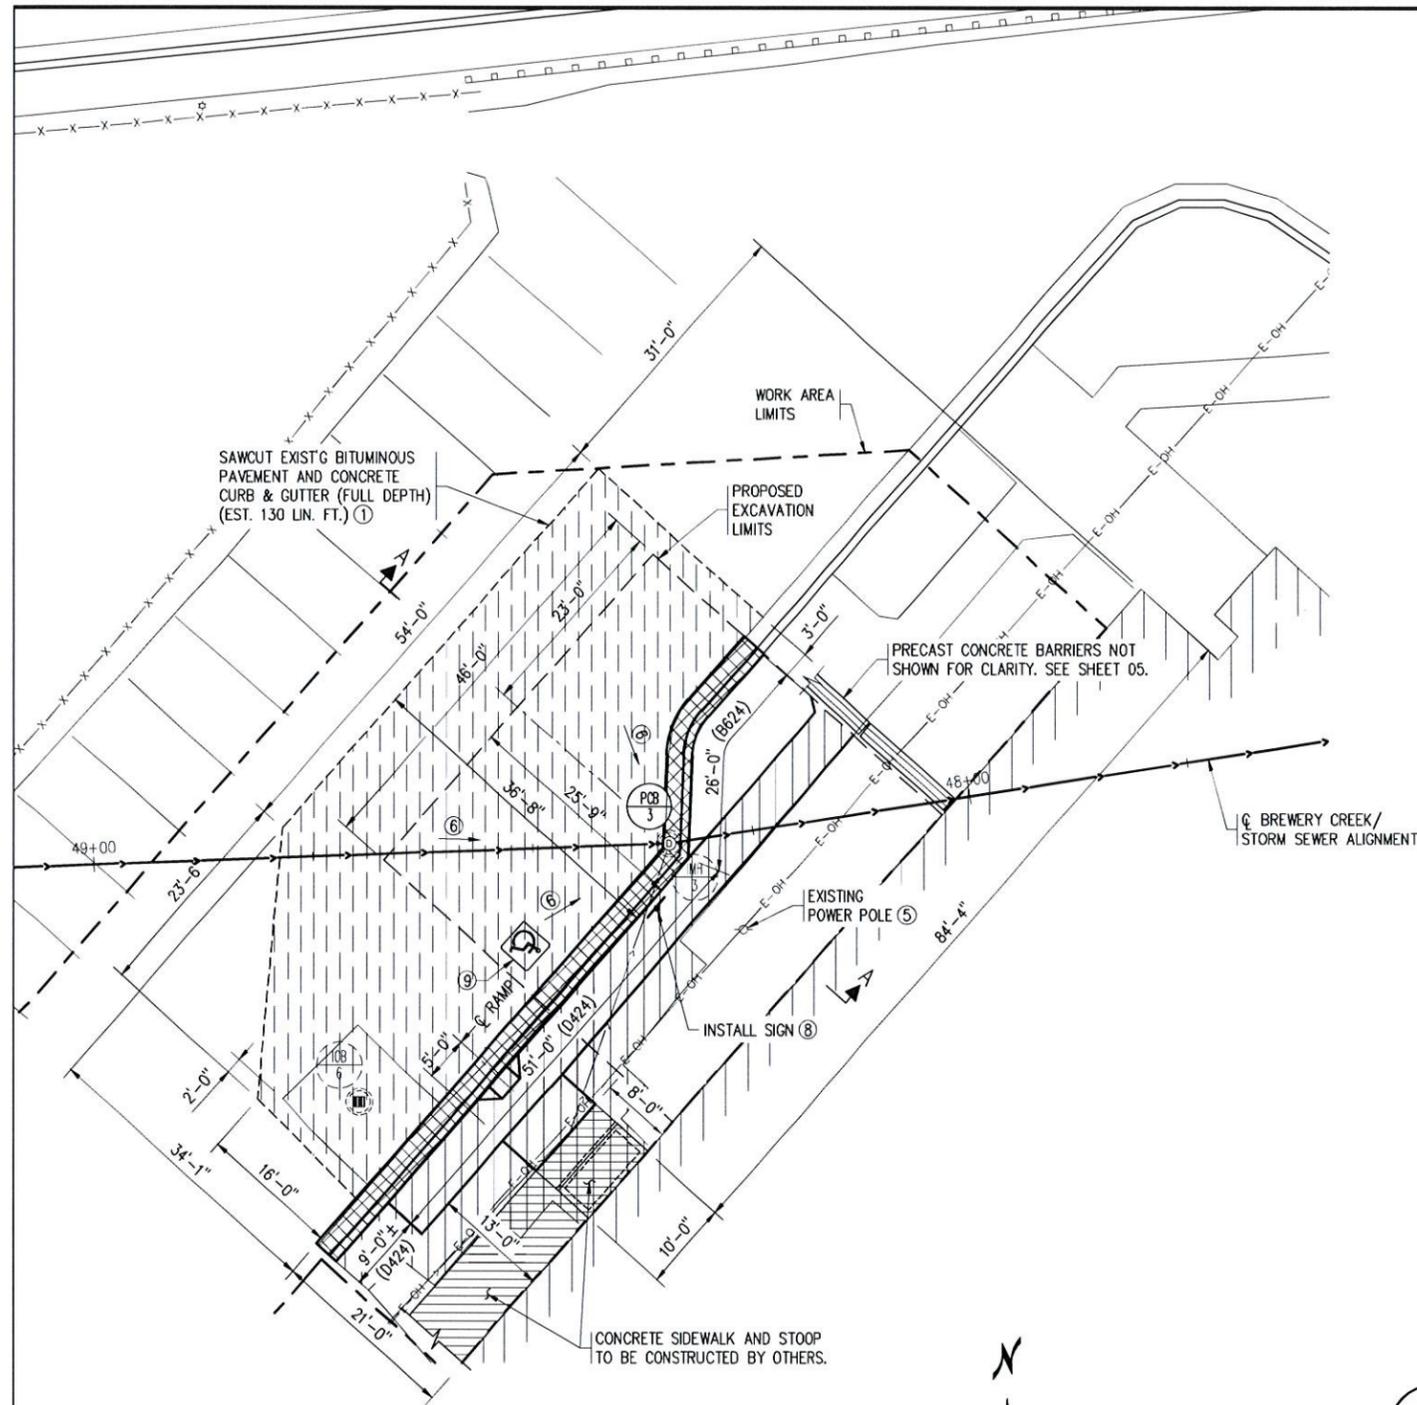


SEWER ACCESS PLAN - SECTION 31

SCALE: 0 10'

LEGEND:

- DENOTES SIDEWALK REMOVAL (EST. 800 SQ. FT.) AND REPLACEMENT (475 SQ. FT.) TO BE PAID FOR UNDER ITEMS "REMOVE CONCRETE WALK" AND "5" CONCRETE WALK".
- DENOTES BITUMINOUS REMOVAL (EST. 2110 SQ. FT.) AND REPLACEMENT (EST. 55 TONS). TO BE PAID FOR UNDER ITEMS "REMOVE BITUMINOUS PAVEMENT" AND "TYPE SP 12.5 WEARING COURSE MIXTURE (3,C)".
- DENOTES CURB & GUTTER REMOVAL (EST. 86 LIN. FT.) AND REPLACEMENT (26 LIN. FT. OF B624 & 60 LIN. FT. OF D424). TO BE PAID FOR UNDER ITEMS "REMOVE CURB AND GUTTER" AND "CONCRETE CURB AND GUTTER DESIGN B624/D424".

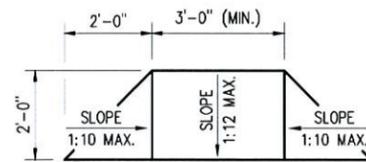


CURB RAMP DETAIL

(REFER TO MN/DOT STANDARD PLATE 7035N FOR DETAILS UNLESS NOTED OTHERWISE)


KEY NOTES:

- ① TO BE PAID FOR UNDER ITEM "SAWCUT BITUMINOUS PAVEMENT (FULL DEPTH)".
- ② IF SLOPES ARE REQUIRED TO BE FLATTER THAN THAT SHOWN IN THE PLANS DUE TO SOIL CONDITIONS, OSHA REQUIREMENTS, PRESENCE OF STRUCTURES OR OTHER REASONS THE CONTRACTOR SHALL PROVIDE SUITABLE SHORING. IN NO CASE SHALL PAVEMENT REMOVAL OR SURFACE DISTURBANCE LIMITS EXCEED THAT SHOWN IN THE PLANS. THE COST FOR SHORING, EXCAVATION, BACKFILL AND SURFACING REQUIRED IN EXCESS OF THAT SHOWN IN THE PLANS SHALL BE BORNE SOLELY BY THE CONTRACTOR AND NO MEASUREMENT OR PAYMENT SHALL BE MADE THEREFORE.
- ③ PAYMENT SHALL BE CONSIDERED INCIDENTAL TO ITEM "STRUCTURE EXCAVATION CLASS E".
- ④ TO BE PAID FOR UNDER ITEM "CONSTRUCT DRAINAGE STRUCTURE DESIGN A OR F".
- ⑤ TO BE RELOCATED BY OTHERS.
- ⑥ SLOPE NEW BITUMINOUS TO DRAIN TO PCB-3 AS DIRECTED BY ENGINEER IN FIELD.
- ⑦ MAXIMUM REMOVAL AND RECONSTRUCTION LIMITS THAT WILL BE ELIGIBLE FOR PAYMENT UNDER CONTRACT ITEMS.
- ⑧ INSTALL SIGN PER "SIGN DETAIL" ON SHEET 02. LOCATION SHALL BE DETERMINED BY ENGINEER IN FIELD. TO BE PAID FOR UNDER ITEM "INSTALL SIGN".
- ⑨ PAINT HANDICAPPED SYMBOL WITHIN PARKING AREA AS DIRECTED BY ENGINEER IN FIELD. TO BE INCLUDED FOR PAYMENT UNDER ITEM "PAVEMENT MESSAGE (HANDICAPPED SYMBOL) PAINT".

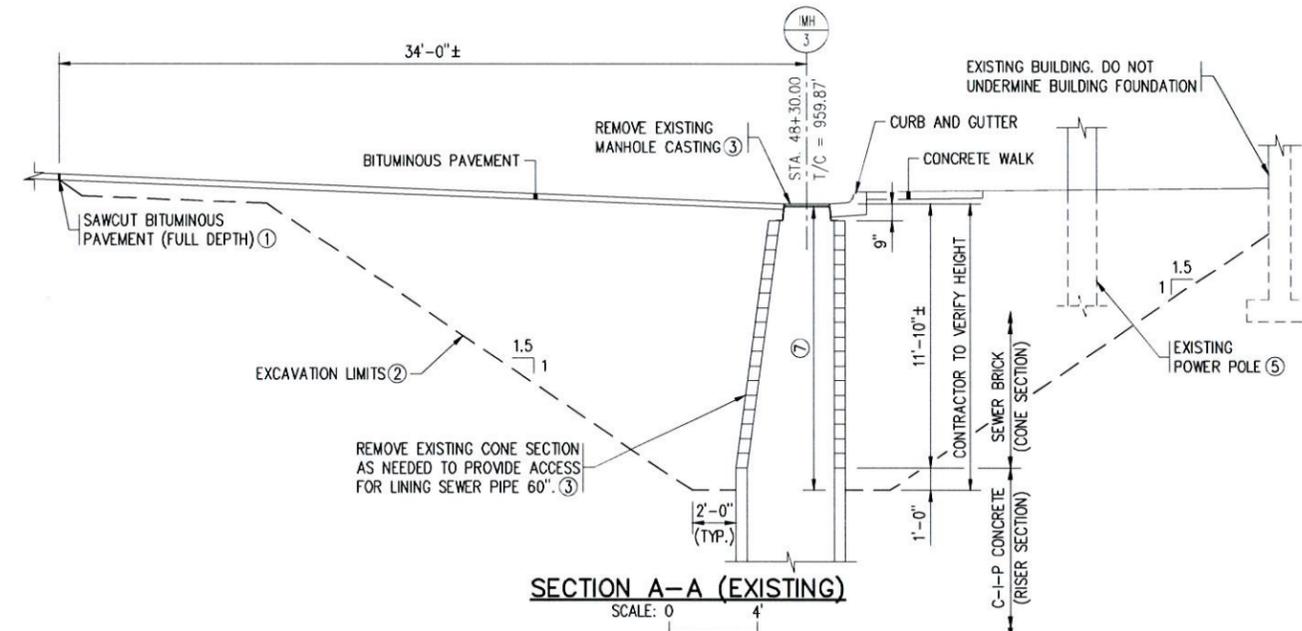


SECTION A-A (EXISTING)

SCALE: 0 4'

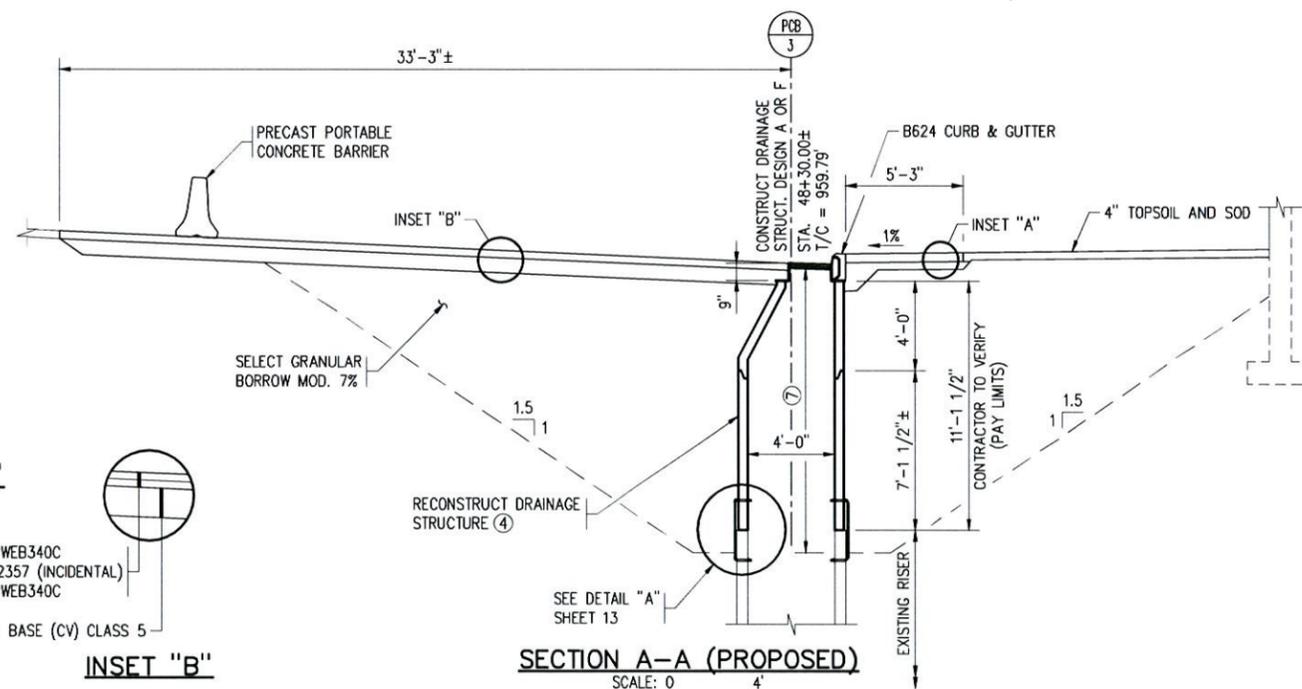


SECTION A-A (PROPOSED)

SCALE: 0 4'



INSET "A"



INSET "B"

2" TYPE SP 12.5 WEARING COURSE MIXTURE (3,C) SPWEB340C
PLACE TACK COAT BETWEEN BIT. COURSES - SPEC. 2357 (INCIDENTAL)
2" TYPE SP 12.5 WEARING COURSE MIXTURE (3,C) SPWEB340C

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: *John W. Sitter* LIC. NO. 25128 DATE 08/14/2015
JOHN W. SITTER

City of Duluth Proj. No. 0036ST

SEWER ACCESS DETAILS - PHASE A

Sheet No. 09 of 13 Sheets

APPROX. EXISTING STORM SEWER DIMENSIONS							
STATION	48+32	48+50	48+75	49+00	49+25	49+50	49+58
INSIDE HEIGHT (INCHES)	67	67.5	65	65.5	65	67	66
INSIDE WIDTH (INCHES)	70	71	69	71	73	72	72


THE INFORMATION GIVEN IN THE TABLE ABOVE IS FOR INFORMATION ONLY. THE CONTRACTOR SHALL VERIFY EXISTING PIPE SIZE OPENINGS AND SHALL COORDINATE HIS WORK AS REQUIRED TO PERMIT SATISFACTORY INSTALLATION OF THE PIPE LINER AS REQUIRED BY THE CONTRACT.

LEGEND:

-  DENOTES PROPOSED CONCRETE REMOVAL. PAID FOR UNDER ITEM "REMOVE CONCRETE FLOOR". (6)
-  DENOTES PRESSURE GROUTED AREA BETWEEN EXISTING PIPE AND PROPOSED LINING


KEY NOTES:

- 1 EXISTING CONE SECTION CONSTRUCTED OF SEWER BRICK.
- 2 EXISTING RISER SECTION CONSTRUCTED OF CAST IN PLACE CONCRETE.
- 3 SEE SHEET 09 FOR ADDITIONAL DETAILS.
- 4 APPROXIMATE SLOPE.
- 5 TO BE PAID FOR UNDER ITEM "LINING SEWER PIPE 60\"".
- 6 ESTIMATED 260 SQ. FT. OF "REMOVE CONCRETE FLOOR". IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO FIELD MEASURE AND DOCUMENT LOCATIONS IN THE FIELD WHERE REMOVAL IS REQUIRED TO PERMIT INSTALLATION OF THE LINING. REMOVAL AREAS SHALL BE CLEARLY MARKED BY CONTRACTOR AND APPROVED BY THE ENGINEER PRIOR TO BEGINNING REMOVAL OPERATIONS.
- 7 PAY LENGTH FOR LINING WILL BE MEASURED ALONG SLOPE, NOT HORIZONTALLY.
- 8 ALL PRESSURE GROUT REQUIRED TO FILL VOIDS BETWEEN EXISTING STORM SEWER AND PROPOSED STORM SEWER SHALL BE INCIDENTAL TO ITEMS "LINING SEWER PIPE 60\"".

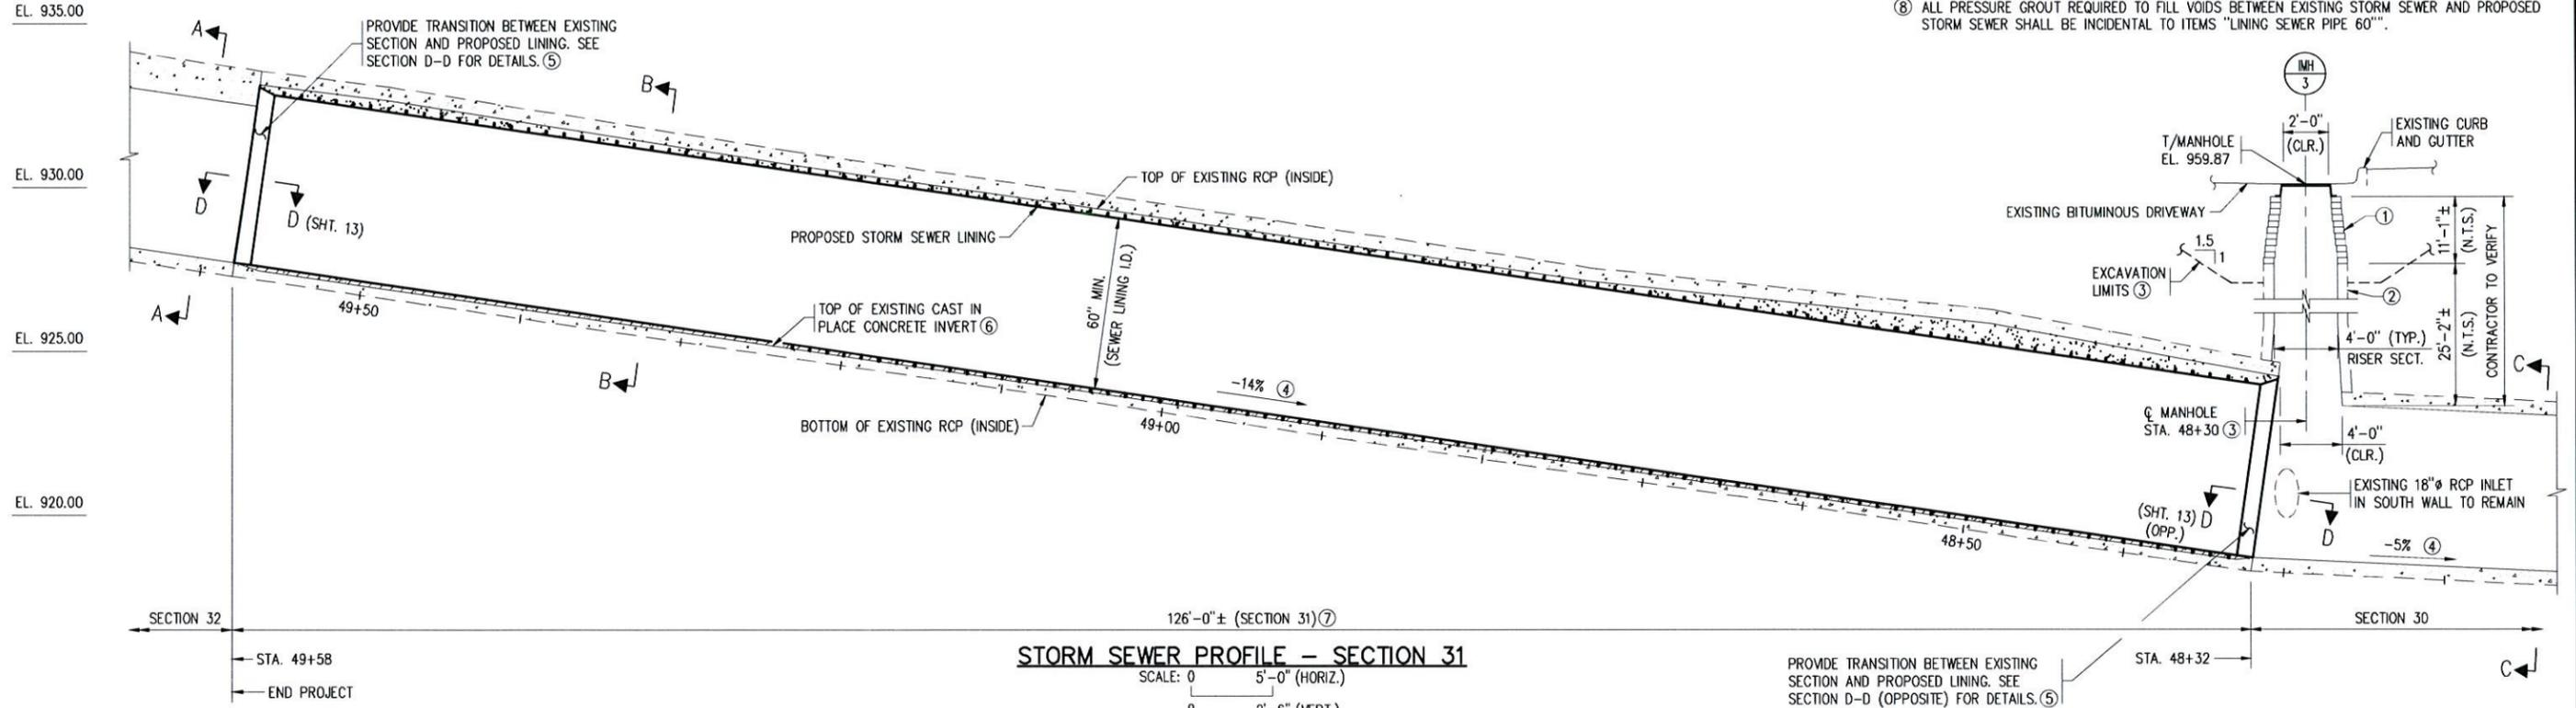


STORM SEWER PROFILE - SECTION 31

SCALE: 0 5'-0" (HORIZ.)
0 2'-6" (VERT.)

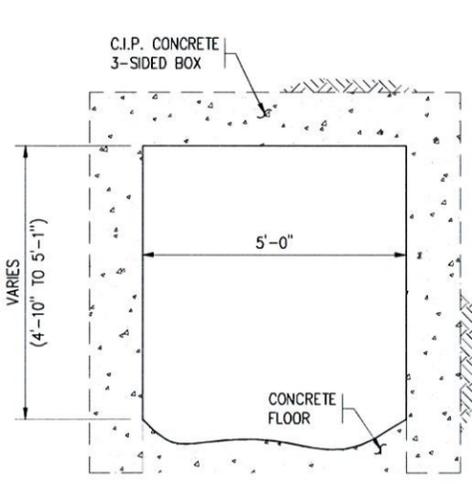


SECTION A-A (SECTION 32)


(NO PROPOSED WORK WITHIN SECTION, SHOWN FOR REFERENCE ONLY)

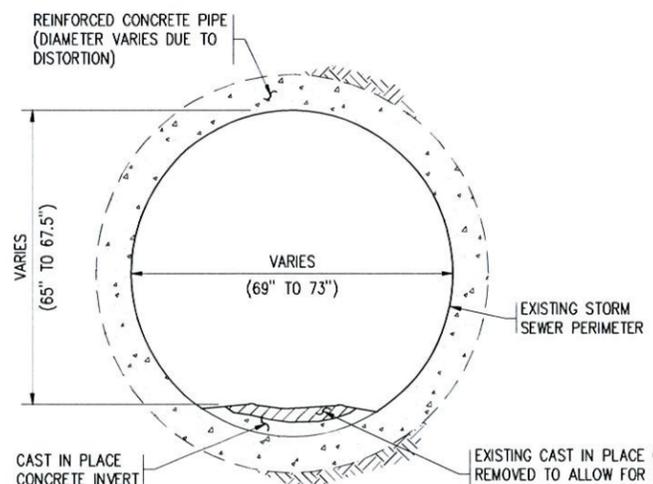

SECTION B-B (EXISTING) (SECTION 31)

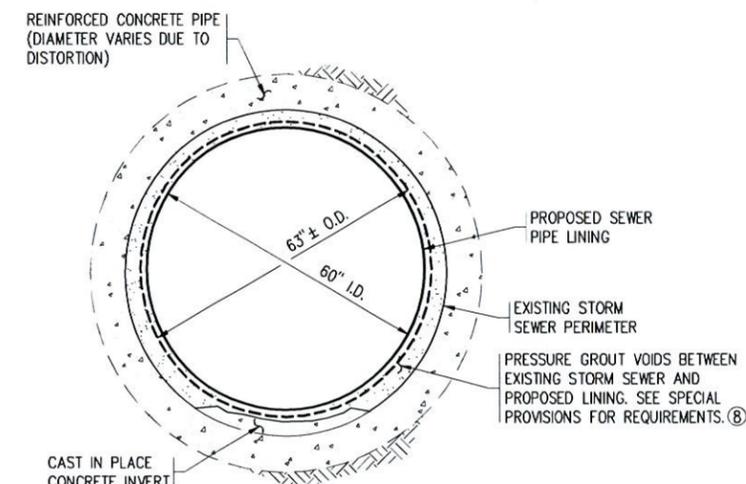

SECTION B-B (PROPOSED) (SECTION 31)

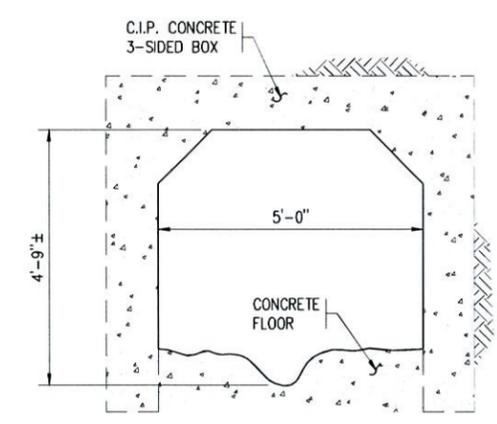

SECTION C-C (SECTION 30)

(NO PROPOSED WORK WITHIN SECTION, SHOWN FOR REFERENCE ONLY)

- NOTES:
1. N.T.S. = NOT TO SCALE
I.D. = INSIDE DIAMETER
O.D. = OUTSIDE DIAMETER

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015


City of Duluth Proj. No. 0036ST

STORM SEWER PROFILE - PHASE A

Sheet No. 10 of 13 Sheets

2" TYPE SP 12.5 WEARING COURSE MIXTURE (3,C) SPWEB340C
 PLACE TACK COAT BETWEEN BIT. COURSES - SPEC. 2357 (INCIDENTAL)
 2" TYPE SP 12.5 WEARING COURSE MIXTURE (3,C) SPWEB340C


8" AGG. BASE (CV) CLASS 5



INSET "A"

KEY NOTES:

- ① TO BE PAID FOR UNDER ITEM "SAWING BITUMINOUS PAVEMENT (FULL DEPTH)".
- ② IF SLOPES ARE REQUIRED TO BE FLATTER THAN THAT SHOWN IN THE PLANS DUE TO SOIL CONDITIONS, OSHA REQUIREMENTS, PRESENCE OF STRUCTURES OR OTHER REASONS THE CONTRACTOR SHALL PROVIDE SUITABLE SHORING. IN NO CASE SHALL PAVEMENT REMOVAL OR SURFACE DISTURBANCE LIMITS EXCEED THAT SHOWN IN THE PLANS. THE COST FOR SHORING, EXCAVATION, BACKFILL AND SURFACING REQUIRED IN EXCESS OF THAT SHOWN IN THE PLANS SHALL BE BORNE SOLELY BY THE CONTRACTOR AND NO MEASUREMENT OR PAYMENT SHALL BE MADE THEREFORE.
- ③ PAYMENT SHALL BE CONSIDERED INCIDENTAL TO ITEM "STRUCTURE EXCAVATION CLASS E".
- ④ TO BE PAID FOR UNDER ITEM "CONSTRUCT DRAINAGE STRUCTURE DESIGN A OR F".
- ⑤ MATCH EXISTING PERIMETER GRADES AND SLOPE TO DRAIN TO ICB-7, 8 & 9 AS DIRECTED BY ENGINEER IN FIELD.
- ⑥ MAXIMUM REMOVAL AND RECONSTRUCTION LIMITS THAT WILL BE ELIGIBLE FOR PAYMENT UNDER CONTRACT ITEMS.
- ⑦ REMOVAL AND REPLACEMENT OF EXISTING STORM SEWER SHALL BE DETERMINED BY ENGINEER IN FIELD.

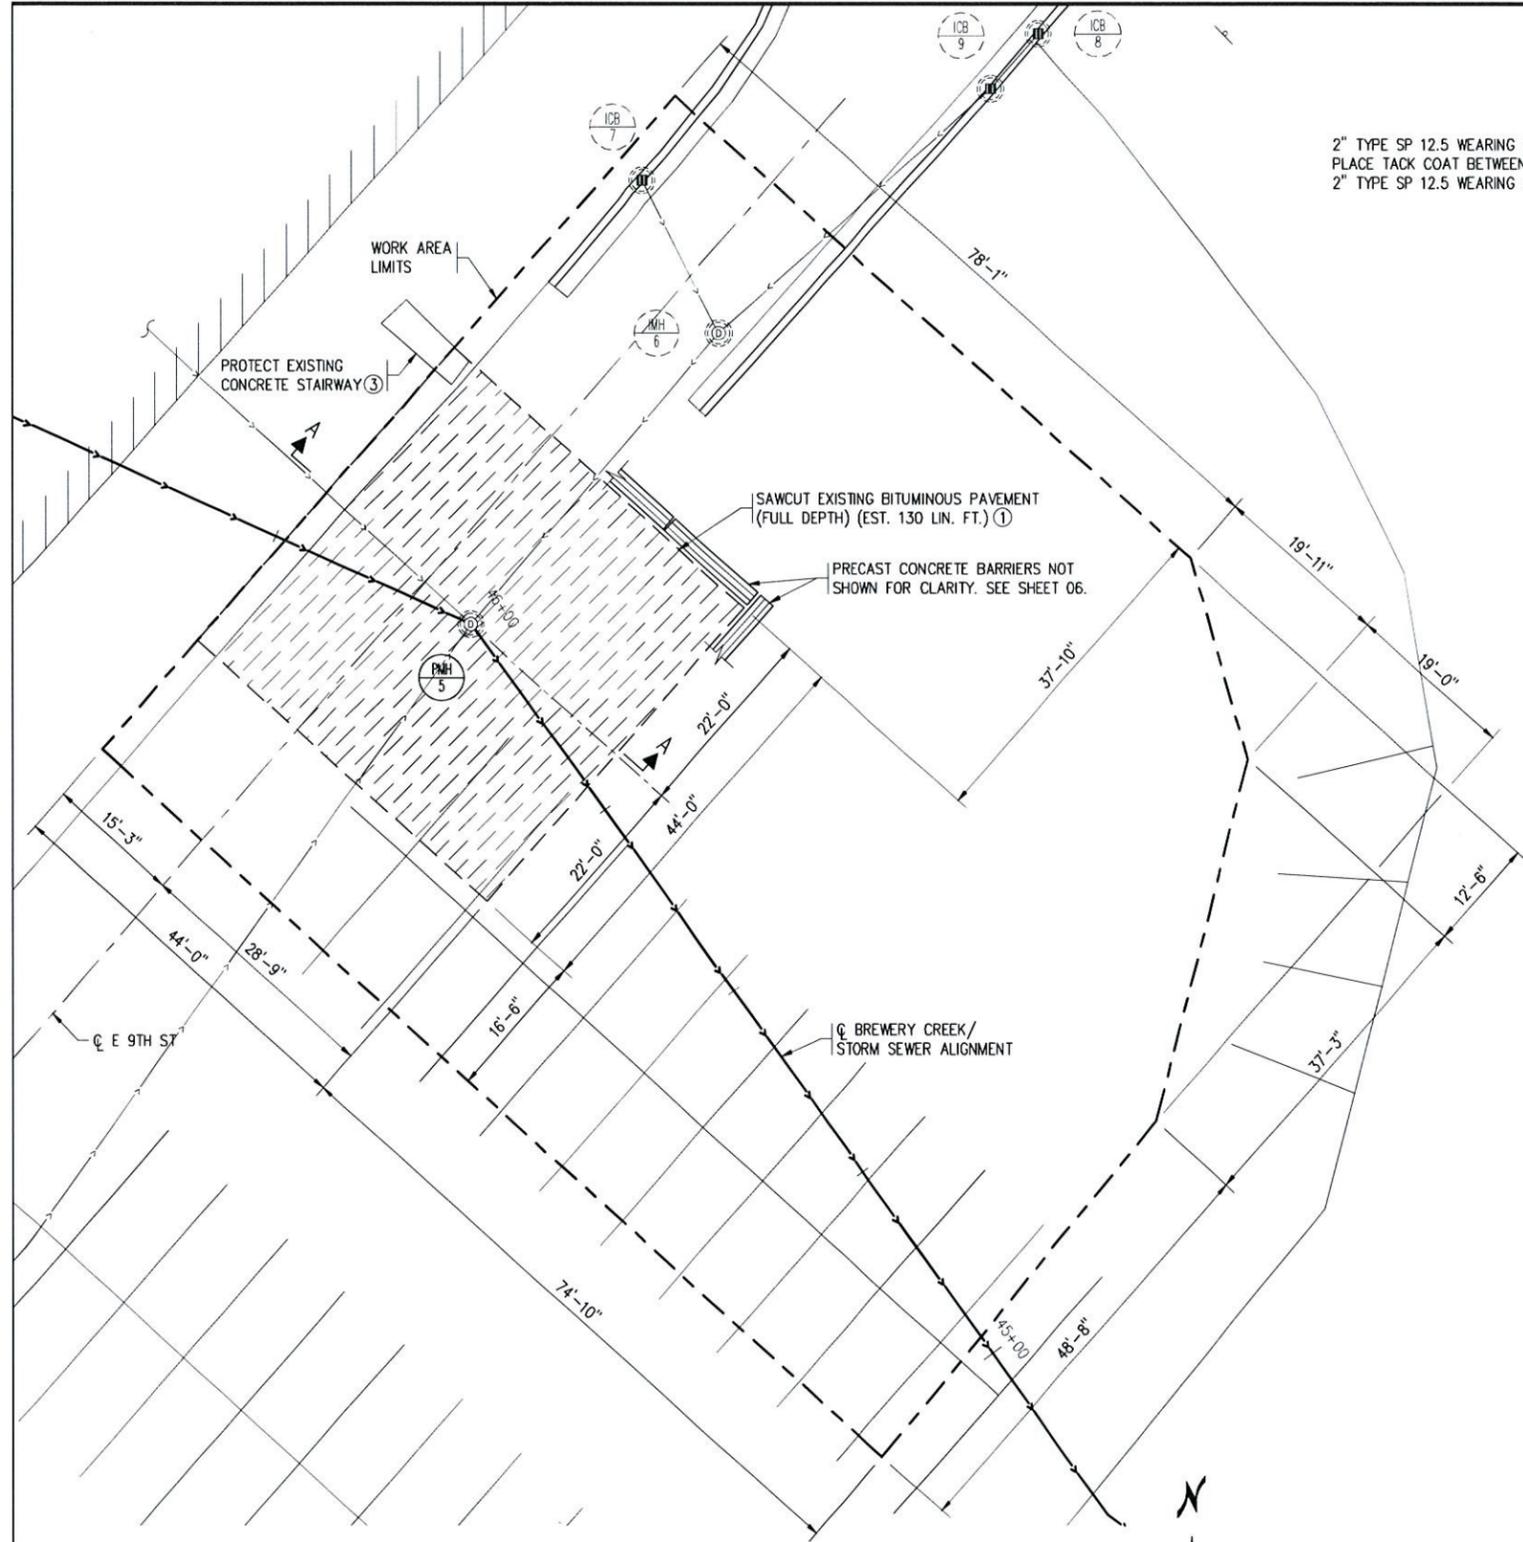


SEWER ACCESS PLAN - SECTION 29

SCALE: 0 10'


LEGEND:

DENOTES BITUMINOUS REMOVAL (EST. 1810 SQ. FT.) AND REPLACEMENT (EST. 50 TONS), TO BE PAID FOR UNDER ITEMS "REMOVE BITUMINOUS PAVEMENT" AND "TYPE SP 12.5 WEARING COURSE MIXTURE (3,C)".

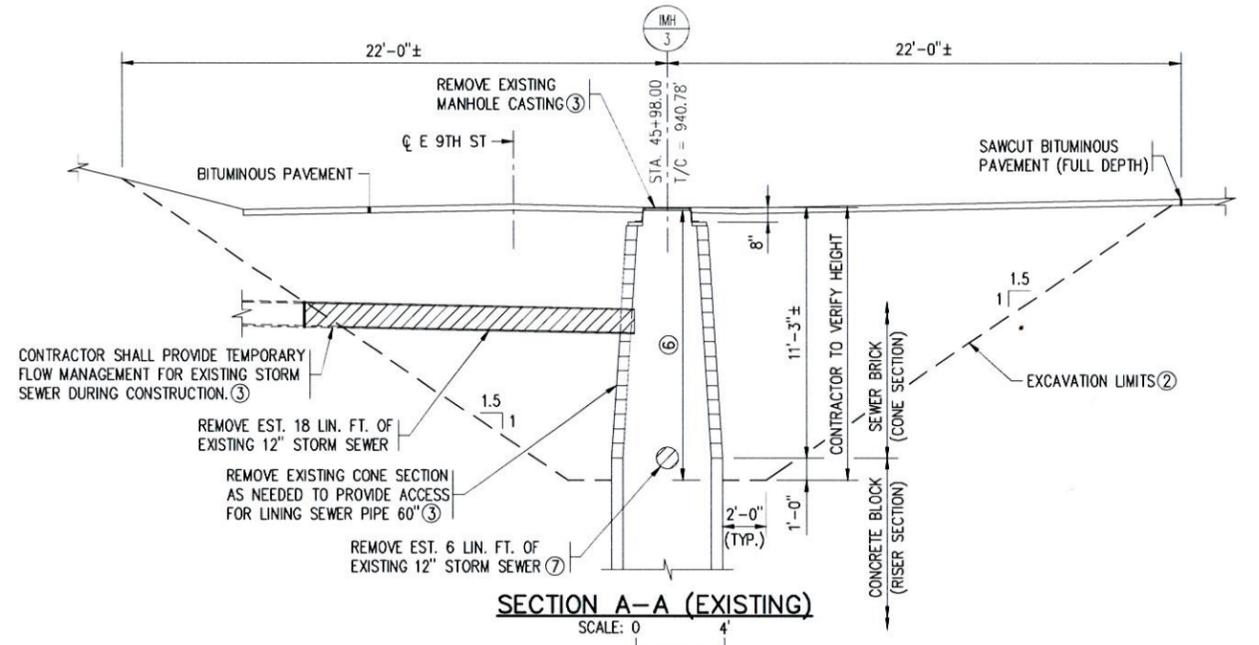

SECTION A-A (EXISTING)

SCALE: 0 4'

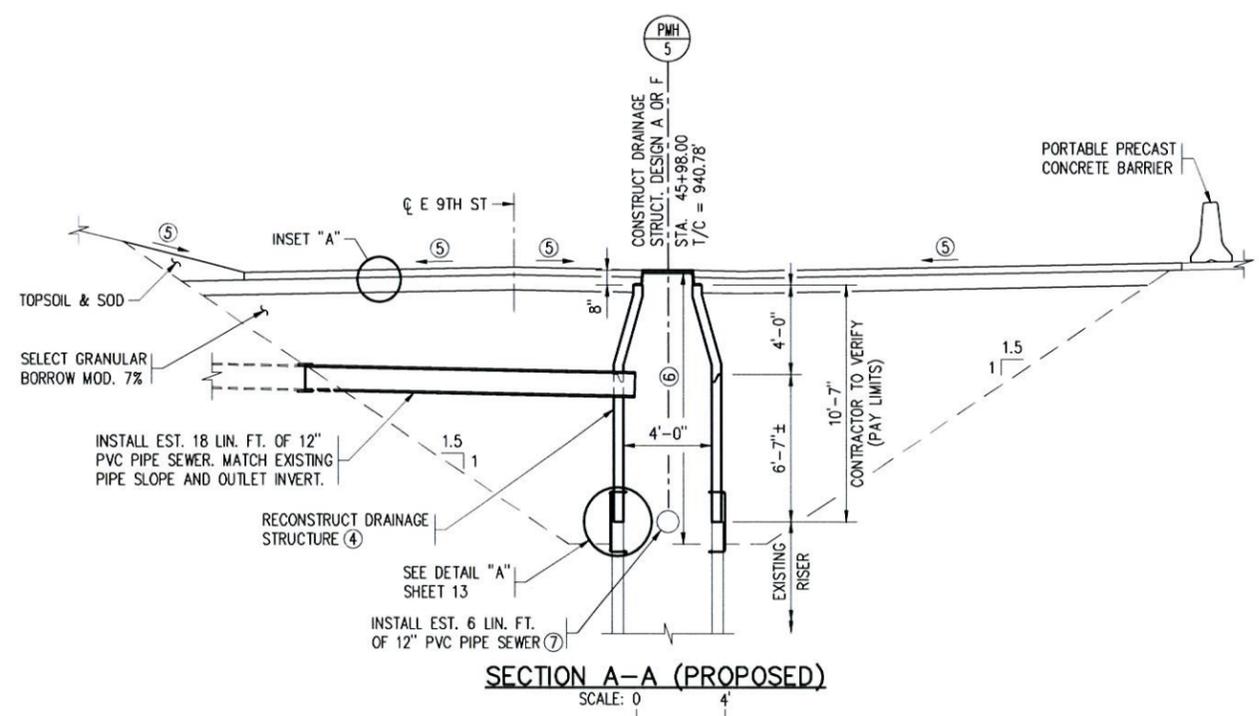

SECTION A-A (PROPOSED)

SCALE: 0 4'

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
 NAME: *John W. Siter* LIC. NO. 25128 DATE 08/14/2015
 JOHN W. SITER

City of Duluth Proj. No. 0036ST

SEWER ACCESS DETAILS - PHASE B



Sheet No. 11 of 13 Sheets

APPROX. EXISTING STORM SEWER DIMENSIONS												
STATION	44+75	45+00	45+25	45+50	45+75	46+00	46+25	46+50	46+75	47+00	47+25	47+45
INSIDE HEIGHT (INCHES)	62	63	63	64	60.5	65	61.5	64	62	60	62	64
INSIDE WIDTH (INCHES)	68	68	68	71	67.5	70	69	71	72.5	75.5	75	70

THE INFORMATION GIVEN IN THE TABLE ABOVE IS FOR INFORMATION ONLY. THE CONTRACTOR SHALL VERIFY EXISTING PIPE SIZE OPENINGS AND SHALL COORDINATE HIS WORK AS REQUIRED TO PERMIT SATISFACTORY INSTALLATION OF THE PIPE LINER AS REQUIRED BY THE CONTRACT.

- LEGEND:**
- DENOTES PROPOSED CONCRETE REMOVAL. PAID FOR UNDER ITEM "REMOVE CONCRETE FLOOR". (4)
 - DENOTES PRESSURE GROUTED AREA BETWEEN EXISTING PIPE AND PROPOSED LINING
 - DENOTES CONCRETE VOID TO BE GROUTED SOLID PRIOR TO LINING SEWER. PAID FOR UNDER ITEM "PRESSURE GROUT".

- KEY NOTES:**
- ① EXISTING CONE SECTION CONSTRUCTED OF SEWER BRICK.
 - ② EXISTING RISER SECTION CONSTRUCTED OF CONCRETE MODULAR BLOCKS.
 - ③ SEE SHEET 11 FOR ADDITIONAL DETAILS.
 - ④ ESTIMATED 540 SQ. FT. OF "REMOVE CONCRETE FLOOR". IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO FIELD MEASURE AND DOCUMENT LOCATIONS IN THE FIELD WHERE REMOVAL IS REQUIRED TO PERMIT INSTALLATION OF THE LINING. REMOVAL AREAS SHALL BE CLEARLY MARKED BY CONTRACTOR AND APPROVED BY THE ENGINEER PRIOR TO BEGINNING REMOVAL OPERATIONS.
 - ⑤ CONTRACTOR SHALL PROVIDE OPENINGS/EXTENSIONS THROUGH PROPOSED SEWER LINING AT ALL EXISTING MANHOLE AND DRAINAGE STRUCTURES WITHIN REPAIRED PIPE SECTION. PAYMENT SHALL BE CONSIDERED INCIDENTAL TO ITEM "LINING SEWER PIPE 60"."
 - ⑥ TO BE PAID FOR UNDER ITEM "PRESSURE GROUT".
 - ⑦ APPROXIMATE SLOPE.
 - ⑧ TO BE MEASURED AND PAID FOR UNDER ITEM "REMOVE CONCRETE FLOOR".
 - ⑨ PAY LENGTH FOR LINING WILL BE MEASURED ALONG SLOPE, NOT HORIZONTALLY.
 - ⑩ TO BE PAID FOR UNDER ITEM "LINING SEWER PIPE 60"."

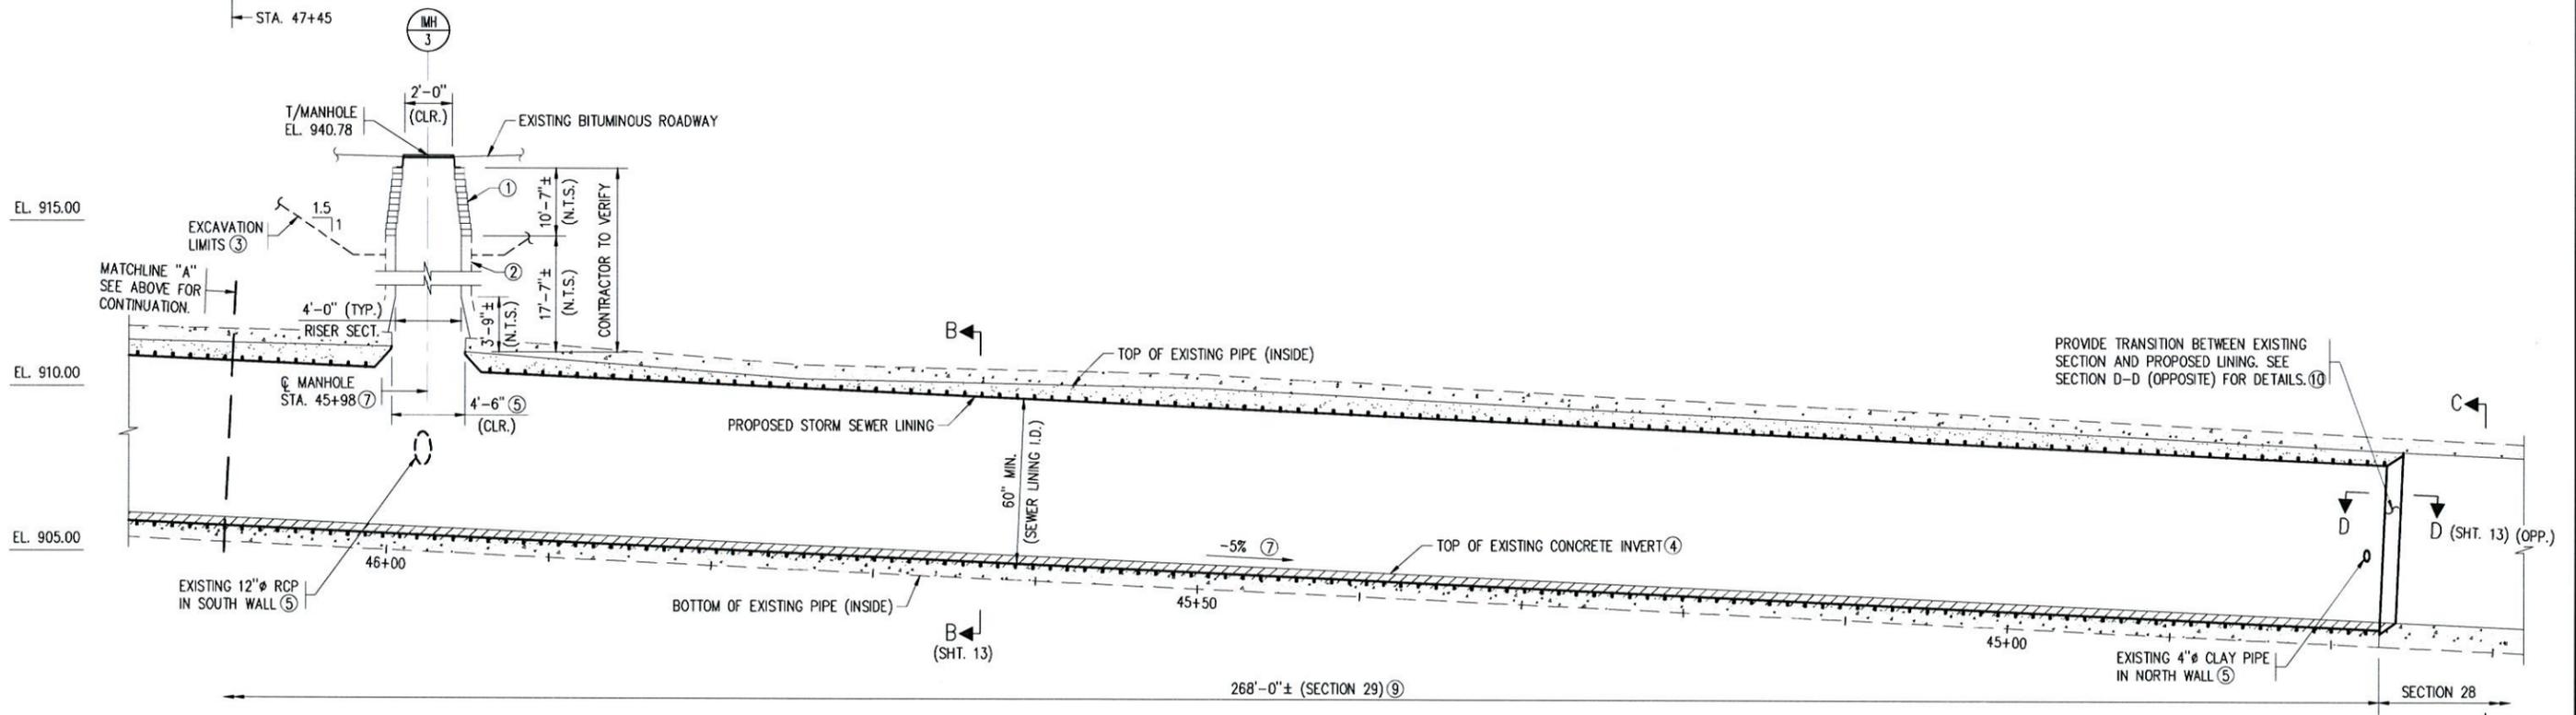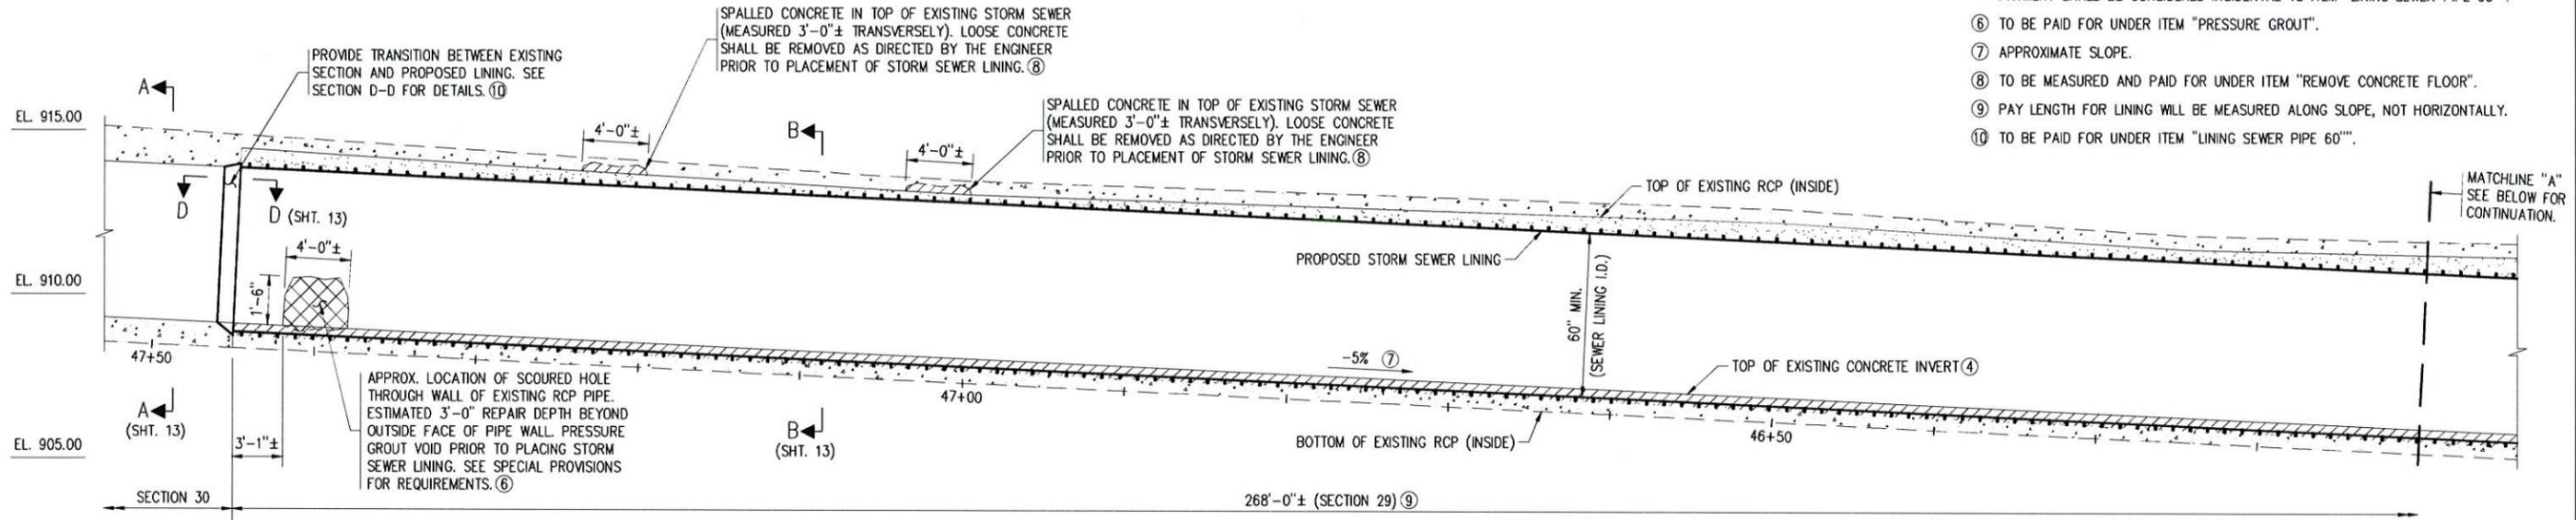


STORM SEWER PROFILE - SECTION 29
 SCALE: 0 5'-0" (HORIZ.)
 0 2'-6" (VERT.)

NOTES:
 1. N.T.S. = NOT TO SCALE
 I.D. = INSIDE DIAMETER

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
 NAME: *Jon W. Sitter* LIC. NO. 25128 DATE 08/14/2015
 JON W. SITTER

City of Duluth Proj. No. 0036ST

STORM SEWER PROFILE - PHASE B
 Sheet No. 12 of 13 Sheets

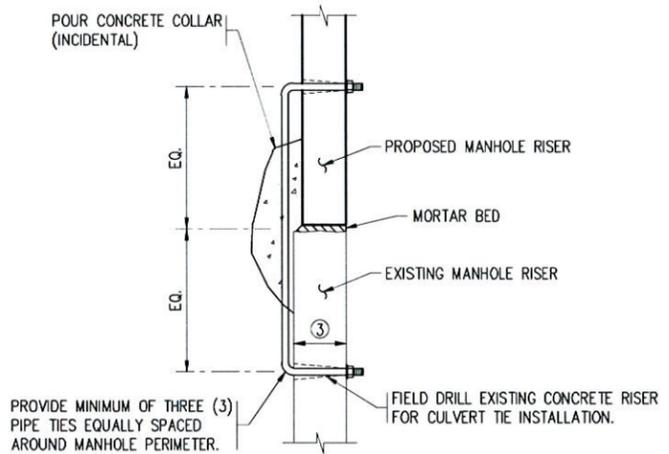


DETAIL "A" ②
(REFER TO MN/DOT STANDARD PLATE 3145G FOR INSTALLATION DETAILS UNLESS NOTED OTHERWISE)

KEY NOTES:


- ① ALL PRESSURE GROUT REQUIRED TO FILL VOIDS BETWEEN EXISTING STORM SEWER AND PROPOSED STORM SEWER SHALL BE INCIDENTAL TO ITEMS "LINING SEWER PIPE 60"
- ② ALL WORK REQUIRED FOR CULVERT TIE INSTALLATION SHALL BE CONSIDERED INCIDENTAL TO ITEM "CONSTRUCT DRAINAGE STRUCTURE DESIGN A OR F"
- ③ VERIFY EXISTING CAST-IN-PLACE RISER THICKNESS PRIOR TO CULVERT TIE FABRICATION.

LEGEND:


- DENOTES PROPOSED CONCRETE
- DENOTES PRESSURE GROUTED AREA BETWEEN EXISTING PIPE AND PROPOSED LINING
- DENOTES INVERT REMOVAL

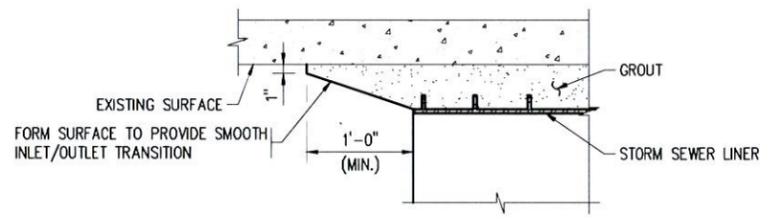

SECTION D-D
(GENERAL TRANSITION SECTION SHOWN)

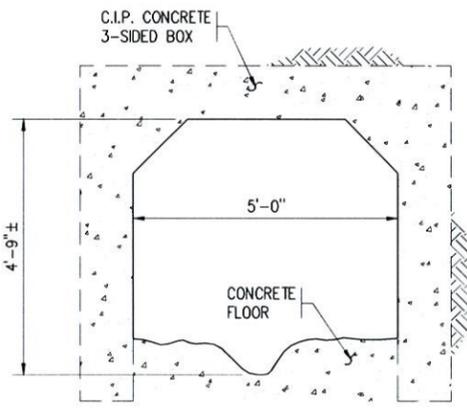


SECTION A-A (SECTION 30)
(NO PROPOSED WORK WITHIN SECTION, SHOWN FOR REFERENCE ONLY)

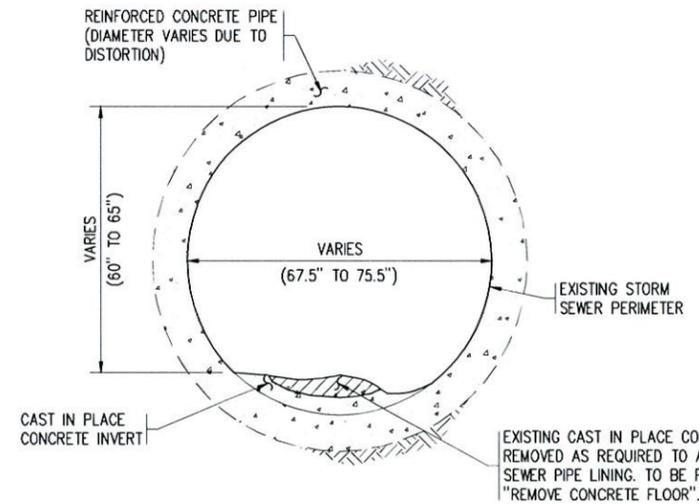


SECTION B-B (EXISTING) (SECTION 29)

EXISTING CAST IN PLACE CONCRETE INVERT SHALL BE REMOVED AS REQUIRED TO ALLOW FOR PLACEMENT OF SEWER PIPE LINING. TO BE PAID FOR UNDER ITEM "REMOVE CONCRETE FLOOR".

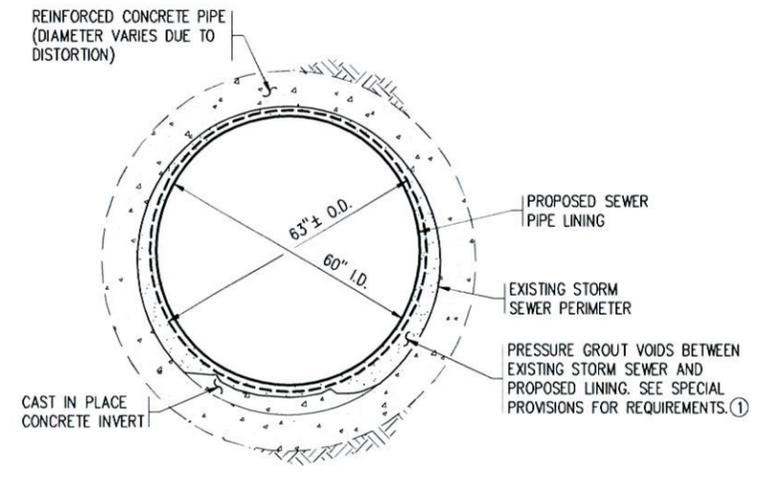

SECTION B-B (PROPOSED) (SECTION 29)

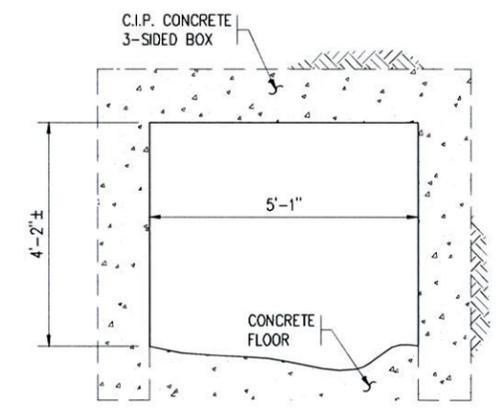

SECTION C-C (SECTION 28)
(NO PROPOSED WORK WITHIN SECTION, SHOWN FOR REFERENCE ONLY)

NOTES:
1. I.D. = INSIDE DIAMETER
O.D. = OUTSIDE DIAMETER

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
NAME: *Jon W. Siter* LIC. NO. 25128 DATE 08/14/2015
JON W. SITER

City of Duluth Proj. No. 0036ST

STORM SEWER DETAILS

Sheet No. 13 of 13 Sheets